



HPOIL GAS PRIVATE LIMITED
(A Joint Venture of HPCL & OIL)

**SUPPLY OF 3LPE COATED LINE PIPES FOR CITY
GAS DISTRIBUTION PROJECTS AT
NAGALAND GA**

**COMMERCIAL VOLUME
(OPEN DOMESTIC COMPETITIVE BIDDING)**

Tender No.: HOGPL/2025-26/C&P/040

Date: 24.02.2026



HPOIL Gas Private Limited

INDEX

| <u>SL.NO.</u> | <u>DESCRIPTION</u> | <u>PAGE NO.</u> |
|---------------|---|-----------------|
| 1.0 | MATERIAL REQUISITION | 03 to 13 |
| 2.0 | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | 14 to 44 |
| 3.0 | STANDARD SPECIFICATION FOR SEAMLESS (SMLS) LINE PIPE (ONSHORE) | 45 to 68 |
| 4.0 | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | 69 to 93 |
| 5.0 | I T P– WELDED PIPES | 94 to 99 |
| 6.0 | I T P SEAMLESS PIPES | 100 to 105 |
| 7.0 | I T P – 3-LAYER PE COATING OF LINE PIPES | 106 to 111 |
| 8.0 | CHECKLIST | 112 |
| 9.0 | COMPLIANCE STATEMENT | 113 |
| 10.0 | DEVIATION SHEET | 114 |
| 11.0 | INSTRUCTION TO BIDDER | 115 |
| 12.0 | REFERENCE LIST | 116 |
| 13.0 | VENDOR DRAWINGS DOCUMENT SCHEDULE | 117 |
| 14.0 | SCOPE OF WORK | 118 to 126 |
| 15.0 | DRAWING – DUMP SITE DEVELOPMENT | 127 |
| 16.0 | DRAWING – BARBED WIRE FENCING | 128 |



**CITY GAS DISTRIBUTION PROJECT
OF
NAGALAND GA**

| | | | | | | |
|--|------|-----|----------------------|----|--|--|
| MATERIAL REQUISITION FOR LINE PIPES | | | CLIENT JOB NO | | PI/HOGPL/001/21-22 Dated 18-05-2021 | |
| | | | TOTAL SHEETS | | 11 | |
| DOCUMENT NO | 1001 | CGD | PL | MR | 001 | |

HPOIL GAS PRIVATE LIMITED

**CITY GAS DISTRIBUTION PROJECT
OF
NAGALAND GA**

MATERIAL REQUISITION

**FOR
LINEPIPE**

| | | | | | |
|------------|-------------|------------------------|-------------|------------|-------------|
| | | | | | |
| D1 | 18.05.2021 | ISSUED FOR PROCUREMENT | | | |
| REV | DATE | DESCRIPTION | PREP | CHK | APPR |



**CITY GAS DISTRIBUTION PROJECT
OF AMBALA-KURUKSHETRA & KOLHAPUR DISTRICT**

TABLE OF CONTENTS

| | | |
|-----|------------------------------------|----|
| 1.0 | INTRODUCTION..... | 3 |
| 2.0 | PURPOSE..... | 3 |
| 4.0 | DOCUMENT PRECEDENCE..... | 3 |
| 5.0 | SCOPE OF SUPPLY..... | 4 |
| 6.0 | BILL OF MATERIAL..... | 4 |
| 7.0 | DESIGN DATA..... | 5 |
| 8.0 | DOCUMENTS & DATA REQUIREMENTS..... | 7 |
| 9.0 | LIST OF ATTACHMENTS..... | 10 |

| | | | |
|---|--|---------------------|------------|
|  | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 2 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF AMBALA-KURUKSHETRA & KOLHAPUR DISTRICT**

1.0 INTRODUCTION

HPOIL Gas Private limited (HOGPL) consortium of HPCL & OIL has received the authorization from PNGRB vide letter PNGRB vide letter PNGRB/CGD/BID/8/2018/ GA/Ambala-Kurukshetra District dated 22/02/2018, PNGRB/CGD/BID/8/2017/BEC/GA-Kolhapur dated 06/03/2018 and PNGRB/Auth/CGD(06)/(2023)/12.04 Nagaland State dt. 04/03/2024 to Lay, Build and Operate City Gas Distribution networks in Ambala-Kurukshetra, Kolhapur District and Nagaland State. HOGPL (hereinafter referred as Owner), is supplying Piped Natural Gas (PNG) to domestic, commercial, and Industrial consumers and Compressed Natural Gas (CNG) to automobiles in Ambala-Kurukshetra and Kolhapur District.

2.0 PURPOSE

This document is for the design, manufacturing and purchase of line pipe for City gas distribution project in Nagaland GA.

3.0 DEFINITIONS

Where used in this document, the following terms shall have the meanings indicated below, unless clearly indicated by the context to this order

- PROJECT : CITY GAS DISTRIBUTION PROJECT OF Nagaland GA.
- OWNER/PURCHASER : HPOIL GAS PRIVATE LIMITED (HOGPL)
The party, which manufactures and supplies equipment and
- MANUFACTURER } : services to the OWNER.
- /VENDOR } : Material Requisition.
- MR }

4.0 DOCUMENT PRECEDENCE

It shall be the responsibility of the MANUFACTURER/ VENDOR to inform the PURCHASER of any errors, ambiguities, inconsistencies, discrepancies or conflict of information that may be found to exist in any document, specification or drawing submitted by the PURCHASER. In case of conflict, the order of precedence shall be as follows:

| | | | |
|--|--|---------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 3 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF NAGALAND GA**

- a. MR
- b. Basic Documents (Specifications)
- c. Codes and Standards

As a rule in the event of any discrepancy between technical matter and local laws/regulations (and documents above listed) the most stringent shall be applied.

MANUFACTURER/ VENDOR shall notify PURCHASER of any apparent conflicts between MR, specifications, related datasheets, any code and standards and any other specifications noted herein. (Resolution and/ or interpretation precedence shall be obtained from PURCHASER in writing before proceeding with the design/ manufacturer or completion of services.)

5.0 SCOPE OF SUPPLY

| S. No. | DESCRIPTION | QTY | REMARKS |
|--------|--|---|---------------------------|
| 1.1 | Pipes | As per Bill of Material Clause 6.0 of this document | |
| 1.2 | Painting and 3LPE Coating | 1 LOT | As per specification |
| 1.3 | Inspection and Testing | 1 LOT | As per specification |
| 1.4 | Inspection and Test Plan | 1 LOT | To be submitted by vendor |
| 1.5 | Certification accordance with EN10204, 3.2 certificates. | 1 LOT | As per specification |
| 1.6 | Vendor Documentation | 1 LOT | As per specification |
| 1.7 | Marking, Packaging & Transportation | 1 LOT | As per specification |
| 1.8 | Preparation for Shipment | 1 LOT | As per specification |
| 1.9 | Delivery Point | Delivery location as defined in the Tender | |
| 1.10 | Delivery Schedule | Delivery Schedule as defined in the Tender | |

6.0 BILL OF MATERIAL

Manufacturing, Inspection, testing and supply of line pipe as per specifications HOGPL-001 & HOGPL-002 including 3LPE coating as per specification -HOGPL-003, packing, transportations, handling delivery of coated & Bare pipe as per tender conditions, including supply of documentation/ drawings as per the enclosed specifications, and other codes and standards enclosed or referred.

| | | | |
|--|--|---------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 4 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF NAGALAND GA**

| SI. N | SIZE (Inch) | THK. (mm) | MATERIAL (PSL-2) | EXTERNAL COATING | METHOD OF MANUFACTURE | QTY (Mtr) |
|-------|-------------|-----------|------------------|------------------|-----------------------|-----------|
| | | | | | | COATED |
| 1. | 8" | 6.4 | API 5L GR.B | 3LPE | HFW/SMLS | 11907 |
| 2. | 6" | 6.4 | API 5L GR.B | 3LPE | HFW/SMLS | 18990 |

Abbreviations

- 1) HFW – High frequency welded
- 2) SMLS – Seamless

7.0 DESIGN DATA

| Description | Value |
|---------------------------|---|
| Product | Natural Gas |
| Design Pressure (Maximum) | 49 bar |
| Material Specification | API 5L X- 60 / API 5L GR.B |
| Corrosion Allowances | 0.5 mm |
| Corrosion Protection | 3 layer PE coated and Cathodic Protection |

NOTES:

- 1.0 Manufacturer shall have valid API license throughout the manufacturing period.
- 2.0 Charpy impact test shall be carried out at (-)29°C.
- 3.0 Quantity may vary \pm 5% for coated pipe . Final quantity will be informed to successful bidder.
- 4.0 Hydro test shall be carried out at 95% of SMYS for 15 min.
- 5.0 Pipes shall be supplied between 11.5 m to 12.5 m.
- 6.0 Delivery of the pipe shall be as following:

| | | | |
|--|--|---------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 5 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

NAGALAND GA

| PIPE SIZE | COATED PIPE | DELIVERY PERIOD |
|-----------|-------------|--|
| | (Mtrs) | |
| 8 INCH | 8000 | To be delivered within 12 weeks from the date of LOI/PO. |
| 6 INCH | 8000 | |

- 8.0 Supply of all coating materials as per specification no. HOGPL-003 for carrying out 3-layer polyethylene coating. The minimum thickness of finished coating shall be as follows:
- 8 inch dia = 2.0 mm
 - 6 inch dia = 2.0 mm
- 9.0 All works associated with the supply of coated line pipes and maintenances of dump yard are detailed in "Scope of work for Procurement of coating line pipes – HOGPL-CGD-PL -SW-0001"
- 10.0 Proposed location of Storage Yards for pipes shall be adjacent to State Highway / National Highway approach and near to right of use (ROU). Owner shall arrange for adequate land for Storage Yards. Bidder shall unload stack the pipe. Bidder to refer SOW document (- HOGPL-CGD-PL -SW-0001") for detailed scope of work.
- 11.0 Handling, transportation, loading/ unloading and stacking/ coated line pipes within the coating yard.
- 12.0 For butt weld end, bevel shall be in accordance with API specification 5L or ASME B16.25 as applicable.
- 13.0 Bevel Protector or end caps shall be installed on all pipe ends. End caps shall be hookable type which shall allow the use of end hooks without the need for their removal during pipe handling. The bevel protector shall be the re-usable type. The details of the bevel protector/end caps shall be furnished for approval prior to start of the production.
- 14.0 All major damage to pipe ends/ bevels, including dents or gauges, shall be repaired by removal of damaged pipe material and re-beveling. No welding on the pipe surface shall be allowed. During inspection at storage yard if owner get a defective pipe & the pipe is

| | | | |
|--|--|---------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 6 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

- un-acceptable to owner, then that pipe shall be replaced by supplier without any extra cost.
- 15.0 Inspection of Field Test and Warranty
 - 16.0 Purchaser shall be reimbursed by Manufacturer for any pipe furnished on this order that fails under field hydrostatic test if such failure is caused by a material/manufacturing defect in the pipe. The reimbursement cost shall include pipe, labour and equipment rental for finding, excavating, cutting out and installation of replaced pipe in position. The field hydrostatic test pressure will not exceed that value which will cause a calculated hoop stress equivalent to 95 percent of specified minimum yield strength.
 - 17.0 In case Manufacturer so desires, he will be advised at least two weeks in advance so that his representative may witness the hydrostatic test in field, however, the testing and leak (if any) finding and repair operation shall not be postponed because of absence of the Manufacturer's Representative.
 - 18.0 Bidder shall furnish quotation only in case he can supply material strictly as per this MR and specification forming part of MR.
 - 19.0 ITP for line pipe are enclosed with Bid. Bidder to follow the same.
 - 20.0 If the offer contains any technical deviations or clarifications or stipulates any technical specifications (even if in line with MR requirements) and does not include complete scope & technical/ performance data required to be submitted with the offer, the offer shall be liable for rejection.
 - 21.0 The submission of prices by the Bidder shall be construed to mean that he has confirmed compliance with all technical specifications of the corresponding item(s).
 - 22.0 Inspection and tests performed/witnessed by purchaser's inspector shall in no way relieve the manufacturer's obligation to perform the required inspection and test.
 - 23.0 Bidder must submit all documents/ drawings/ calculations as specified in relevant specification along with his offer and after award of order.
 - 24.0 Purchaser's inspector reserves the right to perform stage wise inspection and witness tests, as indicated in specification at manufacture's works prior to shipment. Manufacturer shall give reasonable notice of time and shall provide without charge reasonable access and facilities require for inspection to the purchaser's inspector. Inspection and tests performed/witnessed by purchaser's inspector shall in no way relieve the manufacturer's obligation to perform the required inspection and test.
 - 25.0 Delivery of pipes shall be at Company/Client designated storage yard and shall be in the Bidder's scope.

8.0 DOCUMENTS & DATA REQUIREMENTS

The table hereunder specifies the quantities and the nature of the documents to be submitted by the Manufacturer to the HOGPL.

The documents required at the inquiry stage and to be included in the bid are listed under column A.

| | | | |
|--|--|---------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 7 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

The documents required after award of the AGREEMENT and subject to the written approval of the HOGPL are listed under column B.

The final and certified documents are listed under column C.

Any document, even when preliminary, shall be binding and therefore duly identified and signed by the Manufacturer. It shall bear the Project reference, the Material Requisition number and the identification number.

The documents are fully part of the supply which shall be complete only when the documents complying fully with the material requisition requirements are received by the engineer.

| Item | Documents and Data | A | | B | | C | |
|------|---|------------------|------------------|--------------------------|------------------|---|--|
| | | Number of copies | Number of copies | Required date | Number of copies | Required date | |
| 1. | Drawing/data submission list and schedule | 3 | 4 | 1 week + monthly | 4 | 2 weeks after approval | |
| 2. | Production, test and delivery schedule (per item) | 3 | 4 | 1 week + monthly | 4 | 2 weeks | |
| 3. | Progress report | -- | 4 | Daily + weekly + monthly | -- | -- | |
| 4. | Catalogues / References | 3 | -- | -- | -- | -- | |
| 5. | Description of application and quality with technical data of 3LPE for external coating | 3 | 4 | 3 weeks | 4 | 2 weeks after approval + with final techn. File | |
| 6. | Code compliance certificate (Quality manual, ISO certificate, API License) | 3 | 4 | 3 weeks | 4 | 2 weeks after approval | |

| | | | |
|--|--|--------------|-----|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 8 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

| Item | Documents and Data | A | B | | C | |
|------|--|------------------|------------------|-------------------|------------------|---|
| | | Number of copies | Number of copies | Required date | Number of copies | Required date |
| 7. | QA/QC program (First Day Production + Regular production separately) | 3 | 4 | 2 weeks | 4 | 2 weeks after approval |
| 8. | Inspection and test procedures | 3 | 4 | 3 weeks | 3 | 2 weeks after approval + with final techn. file |
| 9. | A description with calculation for handling, storage, transportation procedure during total manufacturing cycle and long storage procedure | | 4 | 4 weeks | -- | -- |
| 10. | Duly filled & signed Technical Questionnaire & documents. | 3 | -- | -- | -- | -- |
| 11. | List of fabrication and control operations (LOFC) | -- | 4 | 2 weeks | 4 | 2 weeks after approval |
| 12. | NDE reports & Procedure | -- | 4 | When available | 4 | 2 weeks after approval + with final techn. file |
| 13. | Heat treatment reports (When available) | -- | 4 | When available | 4 | 2 weeks after approval + with final techn. file |
| 14. | Hydrotest and air test report (When available) | -- | 4 | When available | 4 | 2 weeks after approval + with final techn. file |
| 15. | Material certificate | -- | 4 | 1 week after test | 4 | With final techn. file |

| | | | |
|--|--|--------------|-----|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 9 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

| Item | Documents and Data | A | B | | C | |
|------|--|------------------|------------------|---------------|------------------|-------------------------|
| | | Number of copies | Number of copies | Required date | Number of copies | Required date |
| 16. | List of subcontractors with their scope | -- | 4 | 2 weeks | -- | With final techn. file |
| 17. | Copy of purchase orders to subcontractors | -- | 4 | 2 weeks | -- | With final techn. file |
| 18. | Copy of purchase order | -- | -- | -- | -- | With final techn. file |
| 19. | Packing/shipping list w/weights and dimensions | -- | 4 | 4 weeks | 4 | 2 weeks before shipping |
| 20. | Final technical file | -- | -- | -- | 6 | With shipping |

NOTES

1) Durations in column B (Required date) are weeks after Purchase Order date. Durations in column C (Required date) are weeks after document approval. Due date of each document may be proposed.

2) Latest submission time for:

- Test procedure : 2 weeks before test
- Test report : 2 weeks after test

3) Final technical file shall be supplied in hard copy as indicated, and in electronic format (PDF Acrobat files) on two (2) CD-ROMs

9.0 LIST OF ATTACHMENTS

1. Specification for High Frequency Welded Line Pipe-Doc. No. HOGPL-PL-00001.
2. Specification for Seamless (SMLS) Line Pipe (Onshore) – Doc. No. HOGPL-PL-00002.
3. Specification for 3 Layer Polyethylene Coating of Line Pipes- Doc. No. HOGPL-PL-00003.
4. ITP for welded pipes- Doc. No. HOGPL-PL-ITP-001.
5. ITP for seamless pipes- Doc. No. HOGPL-PL-ITP-002.
6. ITP for 3-layer PE coating of line pipes- Doc. No. HOGPL-PL-ITP-003.
7. Checklist- Doc. No. HOGPL-SD-CK-001.
8. Compliance sheet – Doc. No. HOGPL-SD-CS-001.

| | | | |
|--|--|----------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 10 of 11 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

- 9. Deviation sheet – Doc. No. HOGPL-SD-DS-001.
- 10. Instruction to Bidders – Doc. No. HOGPL-SD-ITB-001.
- 11. Reference list – Doc. No. HOGPL-SD-RL-001.
- 12. Vender drawing document schedule – Doc. No. HOGPL-SD-VS-001.
- 13. Scope of Work – Doc. No. 1001-CGD-PL-SW-001.

| | | | |
|--|--|----------------------|------------|
| | MATERIAL REQUISITION FOR LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 11 of 11 | |



**STANDARD SPECIFICATION FOR
HIGH FREQUENCY WELDED LINE PIPE**

| | | | |
|---------------------|-------|--------------|-------|
| | | Total Sheets | 30 |
| DOCUMENT NO. | HOGPL | PL | 00001 |

**STANDARD SPECIFICATION FOR
HIGH FREQUENCY WELDED LINE PIPE**

| REV | DATE | DESCRIPTION | PREP | CHK | APPR |
|-----|------------|----------------------------------|------|-----|------|
| 0 | 18.05.2021 | ISSUED AS STANDARD SPECIFICATION | | | |

CONTENTS

| | | |
|---|--|----|
| 1. SCOPE..... | | 3 |
| 3. NORMATIVE REFERENCES..... | | 3 |
| 6. PIPE GRADE, STEEL GRADE AND DELIVERY CONDITION | | 3 |
| 8 MANUFACTURING | | 4 |
| 9 ACCEPTANCE CRITERIA..... | | 5 |
| 10 INSPECTION..... | | 11 |
| 11 MARKING..... | | 17 |
| 12 COATINGS AND THREAD PROTECTORS | | 17 |
| 13 RETENTION OF RECORDS | | 17 |
| 14 PRODUCTION REPORT..... | | 18 |
| 15 INSPECTION OF FIELD TESTS & WARRANTY | | 18 |

| | | | |
|---|---|---------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 2 of 30 | |

1. SCOPE

This specification establishes the minimum requirements for the manufacture of high frequency welded steel line pipe in accordance with the requirements of API (American Petroleum Institute) Specification 5L, Forty-Fifth Edition, 2012 and makes restrictive amendments to API Specification 5L. Unless modified and/or deleted by this specification, the requirements of API Specification 5L shall remain applicable.

The sections, paragraphs and annexes contained herein have the same numbering as that of API Spec 5L in order to facilitate reference. Additional requirements, which are not specified in API Spec 5L, have also been numbered and marked as "(New)".

The coverage by this specification is limited to line pipe to be used in onshore pipelines transporting non-sour hydrocarbons in liquid or gaseous phase. The product specification level for line pipe to be supplied as per this specification shall be "PSL 2".

The Manufacturer shall have a valid license to use API Monogram in accordance with the requirements of Specification 5L, Forty-Fifth Edition, 2012 for line pipe as Product Specification Level PSL 2.

1.1 Pipe Size

This Specification shall be applied to line pipe of size 4.5" OD thru 20" OD (both sizes included).

3. NORMATIVE REFERENCES

The latest edition (edition enforce at the time of issue of enquiry) of following additional references are included in this specification:

ASTM

ASTM E112-12: Standard Test Methods for Determining Average Grain size

6. PIPE GRADE, STEEL GRADE AND DELIVERY CONDITION

6.1 PIPE GRADE AND STEEL GRADE

6.1.2 Line pipe supplied to this specification shall conform to Product Specification Level 2 (PSL2) as given in Table 1 of this specification and consists of an alpha or alphanumeric designation that identifies the strength level of the pipe. The steel name (designating a steel grade), linked to the chemical composition of the steel, additionally includes a suffix that consists of a single letter (M) that identifies the delivery condition as per Table 3 of this specification.

Table 1 of API Spec 5L stands replaced by Table 1 of this specification.

Table 1- Pipe grades, steel grades and acceptable delivery conditions

| PSL | Delivery Condition | Pipe grade! steel grade ^{a,b} |
|--|--------------------------|---|
| PSL -2 | Thermo mechanical rolled | BM, X42M, X46M, X52M, X56M, X60M, X65M & X70M |
| a Deleted | | |
| b The suffix (M) for PSL 2 grades belongs to steel grade | | |

| | | | |
|---|---|---------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 3 of 30 | |

6.2 DELIVERY CONDITION

6.2.2 The delivery condition for starting material shall be in accordance with Table 1 of this specification.

8 MANUFACTURING

8.1 PROCESS OF MANUFACTURE

Pipe furnished to this specification shall be manufactured in accordance with the applicable requirements and limitations given in Table 2 of API Spec 5L and Table 3 of this specification.

Table 3 of API Spec 5L stands replaced by Table 3 of this specification.

Table 3 - Acceptable manufacturing routes for PSL 2 pipe

| Type of Pipe | Starting Material | Pipe forming | Pipe heat treatment | Delivery condition |
|--------------|-------------------------------|--------------|---|--------------------|
| HFW | Thermo mechanical-rolled coil | Cold forming | Heat treatment of HAZ including weld area | M |

a See clause 8.8 of this specification for applicable heat treatment

High frequency electric welding shall be performed with a minimum welding current frequency of 200 kHz. The welding system shall have an integrated control in which following data as a minimum shall be monitored:

- Welding Temperature
- Welding speed
- Current and Voltage

Abutting edges of the coil shall be milled or machined immediately before welding. The width of the coil shall be continuously monitored.

8.3 STARTING MATERIAL

8.3.2 Line pipe furnished to this specification shall be made from steel produced in basic oxygen or electric arc furnace. Steel shall be made by continuous casting only.

8.3.3 The steel used for manufacturing of pipe shall be fully killed and fine grained with ASTM grain size number 7 or finer as per ASTM E 112.

8.8 TREATMENT OF WELD SEAMS IN EW AND LW PIPES

8.8.2 LW pipe and PSL 2 HFW pipe

The weld seam and the entire Heat Affected Zone (HAZ) shall be heat treated to stimulate a normalizing heat treatment to control the grain structure so that no untampered martensite remains in the weld seam and the HAZ, and the mechanical properties of heat-treated zone approximate that of the parent metal.

Heat treatment temperature of the weld seam and the entire HAZ shall be continuously measured and recorded.

| | | | |
|---|---|--------------|-----|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 4 of 30 | |

8.9 COLD SIZING AND COLD EXPANSION

8.9.1 Pipes furnished to this specification shall be non-expanded.

8.11 JOINTERS

8.11.1 Joints on pipes are not permitted.

9 ACCEPTANCE CRITERIA

9.2 CHEMICAL COMPOSITION

9.2.2 For pipes supplied as per this specification, the chemical composition of each heat of steel on product analysis shall be as given in Table 5 of this specification.

Table 5 of API Spec 5L stands replaced by Table 5 of this specification.

Table 5 - Chemical composition for pipe

| Element | Mass fraction based upon heat and product analyses (%) | |
|--|--|-----------------------------|
| C _b | 0.16 | max. (For Grade B to X56) |
| | 0.12 ^f | max. (For Grade X60 to X70) |
| Si | 0.15 _{m(new)} | min. |
| | 0.45 | max. |
| Mn ^b | 1.20 | max. (For Grade B to X46) |
| | 1.40 | max. (For Grade X52 & X56) |
| | 1.60 | max. (For Grade X60 & X65) |
| | 1.70 | max. (For Grade X70) |
| P | 0.020 | max. |
| S | 0.015 | max. |
| V | 0.05 | max. (For Grade B to X56) |
| | 0.08 ^d | max. (For Grade X60 to X70) |
| Nb | 0.05 | max. (For Grade B to X56) |
| | 0.05 ^d | max. (For Grade X60 to X70) |
| Ti | 0.04 | max. (For Grade B to X46) |
| | 0.04 ^d | max. (For Grade X52 to X60) |
| | 0.06 ^d | max. (For Grade X65 & X70) |
| Al _{a(new)} | 0.02 _{o(new)} | min. |
| | 0.07 | max. |
| Cr | 0.20 | max. |
| Mo | 0.10 | max. |
| Cu | 0.35 | max. |
| Ni | 0.20 | max. |
| N _{n(new)} | 0.012 | max. |
| B | 0.0005 | max. |
| a Based upon product analysis as per clause 9.2.4 and 9.2.5 of API Spec 5L, the CE P _{cm} | | |

limits apply if C ≤ 0.12% and CE_{nw} limits apply if C > 0.12%. For pipes of all grades, sizes and wall thicknesses, Carbon Equivalent shall comply with the following limits:

CE_{Pcm} ≤ 0.20 %

CE_{nw} ≤ 0.40%

Boron content shall be considered in CE_{Pcm} formula even if it is less than 0.0005%.

b Deleted

c Deleted

d Nb + V + Ti = < 0.15%

e Deleted

f Deleted

g Deleted

h Deleted.

l Deleted

j Deleted

k Deleted

l Deleted

(New) m Minimum for Si is not applicable for Al killed steel.

(New) n AlIN shall be minimum 2 (not applicable to titanium-killed steel or titanium-treated steel).

(New) o Applicable for Al killed steel.

9.2.3 For heat analysis and product analysis, all the elements listed in Table 5 of this specification shall be analysed and reported, even if those are not purposely added but are present as residuals only.

If alloying elements other than those specified in Table 5 of this specification are added to the steel, the limits of the additional components shall be agreed with the Purchaser.

9.3 TENSILE PROPERTIES

9.3.2 The finished pipe (after all heat treatment & sizing operations) shall conform to the requirements of Table 7 of API Spec 5L and as modified herein.

The actual yield strength shall be as close as possible to the specified minimum yield strength (SMYS) but in no case it shall exceed the limits specified here under:

| API Spec 5L Grade | Permissible in excess of SMYS, MPa (psi) |
|-------------------------|--|
| Up to and including X46 | 131 (19,000) |
| X52 to X60 | 125 (18,000) |
| X65 to X70 | 120 (17,400) |

The ratio of body yield strength and body tensile strength of each test pipe on which yield strength and ultimate tensile strength are determined, shall not exceed 0.90.

The tensile strength of the weld (after heat treatment of the weld seam) shall be equal to or higher than the specified minimum tensile strength of the base metal.

| | | | |
|---|---|---------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 6 of 30 | |

The minimum elongation of base metal shall be determined in accordance with the formula given in foot note (f) of Table 7 of API Spec 5L, however, minimum elongation in no case shall be less than 20%.

9.6 FLATTENING TEST

Acceptance criteria for flattening tests shall be as follows:

a) For HFW pipe of grade \geq X60 and $t \geq 12.7$ mm, there shall be no opening of the weld before the distance between the plates is less than 66% of the original outside diameter. For all other combinations of pipe grade and specified wall thickness, there shall be no cracks or breaks in either weld or parent metal before the distance between the plates is less than 50% of the original outside diameter. Dye penetrant testing shall be used to positively confirm the presence of crack, break or opening.

b) For HFW pipe with a $D / t > 10$, there shall be no cracks or breaks other than in the weld before the distance between the plates is less than 33% of the original outside diameter.

c) For all pipes, there shall be no evidence of lamination or burnt metal during the entire test before opposite walls of the pipe meet.

Note: The weld extends to a distance of 13 mm on each side of the weld line. The original outside diameter is the specified outside diameter.

9.8 CVN IMPACT TEST FOR PSL 2 PIPE

9.8.1 General

9.8.1.2 From the set of three Charpy V-notch impact test pieces, only one is allowed to be below the specified average absorbed energy value and shall meet the minimum single absorbed energy value requirement as specified in Table 8 of this specification.

9.8.2 Pipe body tests

9.8.2.1 The average (set of three test pieces) absorbed energy value (KvT) for each pipe body test shall be as specified in Table 8 of this specification, based upon full sized test pieces at a test temperature of 0°C(32°F) or at a lower test temperature as specified in the Purchase Order.

Table 8 of API Spec 5L stands replaced by Table 8 of this specification.

**Table 8 - CVN absorbed energy requirements
for pipe body, weld and HAZ of PSL 2 pipe**

| Pipe Grade | Full-size CVN absorbed energy (KvT) ^{a,b} [J] | |
|------------|--|---------|
| | Average | Minimum |
| B | 40 | 33 |
| X42 | 40 | 33 |
| X46 | 40 | 33 |
| X52 | 40 | 33 |
| X56 | 40 | 33 |
| X60 | 42 | 35 |
| X65 | 45 | 38 |
| X70 | 50 | 40 |

a. The required KvL (longitudinal direction test pieces) values shall be 50% higher than the required KvT values.
b. Testing shall be performed at a test temperature of 0° C (32°F) or at a lower temperature as specified in the Purchase Order.

| | | | |
|---|---|--------------|-----|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 7 of 30 | |

9.8.2.2 The minimum average (set of three test pieces) shear fracture area shall be at least 85 % with one minimum value of 75%, based at a test temperature of 0 °C (32 OF) or at a lower test temperature as specified in the Purchase Order.

9.8.3 Pipe weld and HAZ tests

The average (set of three test pieces) absorbed energy value (Kv1) for each pipe weld and HAZ test shall be as specified in Table 8 of this specification, based upon full-size test pieces at a test temperature of 0°C (32°F) or at a lower test temperature as specified in the Purchase Order.

9.10 SURFACE CONDITIONS, IMPERFECTIONS AND DEFECTS

9.10.1 General

9.10.1.2 All pipes shall be free from cracks, sweats, leaks and slivers. Pipe containing such defects shall be treated in accordance with clause C.3 b) or c) of API Spec 5L.

9.10.3 Arc burns

9.10.3.2 Arc bums shall be treated in accordance with clause C.3 b) or c) of API Spec 5L. As a reference method for confirming the existence of an arc bum, the area shall be buffed with wire brush or sanding disc and etched with 10% solution of ammonium per sulphate or a 5% solution of natal.

However, arc bums can be considered for acceptance, in case the same is re-crystallized by seam heat treatment. In such case, the Manufacturer shall demonstrate the re-crystallization to Purchaser by taking a sample as per clause 10.2.3.8 (New) of this specification.

9.10.4 Laminations

Any lamination or inclusion either extending into the face or bevel of the pipe or present within 50 mm from pipe ends shall be classified as defect. Pipes that contain such defects shall be rejected or cut back until no lamination or inclusion is present at the pipe ends and shall be treated in accordance with clause C.3 b) or c) of API Spec 5L.

9.10.5 Geometric deviations

9.10.5.2 For dents, the length in any direction shall be $\leq 0.5 D$ and the depth, measured as the gap between the extreme point of the dent and the prolongation of the normal contour of the pipe, shall not exceed the following:

- a) 3.2 mm for cold-formed dents with sharp-bottom gouges and not encroaching upon the specified minimum wall thickness
- b) 6.4 mm for other dents
- c) 1 mm at the pipe ends, i.e. within a length of 100 mm at each of the pipe ends.
- d) Any dent on weld and heat affected zone (HAZ).

Dents that exceed the above specified limits shall be considered as defect and shall be treated in accordance with clause C.3 b) or c) of API Spec 5L. Acceptable cold-formed dents with sharp-bottom gouges shall be treated in accordance with clause C.2 of API Spec 5L & as modified in this specification.

| | | | |
|---|---|---------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 8 of 30 | |

9.10.6 Hard Spots

Any hard spot larger than 50 mm (2.0 in) in any direction and hardness greater than 248HV 10 shall be classified as defect and treated in accordance with clause C.3 b) or c) of API Spec 5L.

9.10.7 Other surface imperfection

Other surface imperfections found by visual inspection or non-destructive inspection shall be investigated, classified and treated as follows:

a) Imperfections that have a depth $\leq 0.05 t$ and do not encroach on the minimum specified wall thickness shall be classified as acceptable imperfections and shall be treated in accordance with Clause C.1 of this specification.

b) Imperfections that have a depth $> 0.05 t$ and do not encroach on the minimum specified wall thickness shall be classified as defects, and shall be dressed-out by grinding in accordance with Clause C.2 of API Spec 5L and as modified in this specification or shall be treated in accordance with clause C.3 b) or c) of API Spec 5L.

c) Imperfections that encroach on the minimum specified wall thickness shall be classified as defects and treated in accordance with clause C.3 b) or c) of API Spec 5L.

9.11 DIMENSIONS, MASS AND TOLERANCES

9.11.3 Tolerances for diameter, wall thickness, length and straightness

9.11.3.1 The diameter and out-of-roundness shall be within the tolerances given in Table 10 of this specification.

Table 10 of API Spec 5L stands replaced by Table 10 of this specification.

Table 10 - Tolerances for diameter and out-of-roundness

| Specified outside Diameter (D) mm (inch) | Diameter tolerances ^a | | Out-of-roundness | |
|--|--|-------------------------|----------------------------------|----------------------------------|
| | Pipe except the end ^a | Pipe end _{a,c} | Pipe except the end ^a | Pipe end _{a,c} |
| D = < 168.3 (6 3/8) | $\pm 0.0075 D$ | -0.4 mm to + 1.6mm | 0.020D | 0.015 D up to a maximum of 2.0mm |
| 168.3 (6 3/8) < D = < 273.1 (10 3/4) | $\pm 0.0075 D$ | $\pm 0.005 D$ | 0.020D | 2.0mm |
| D > 273.1 (10 3/4) | $\pm 0.0075 D$ up to a maximum of $\pm 3.0\text{mm}$ | $\pm 1.6\text{mm}$ | 0.020D | 3.0mm |

a The pipe end includes a length of 100 mm at each of the pipe extremities.
 b Deleted
 c The diameter tolerance and out-of-roundness tolerance shall apply on inside diameter. The inside diameter, based on circumferential measurement, shall be calculated as $ID = (D - 2t)$.
 d For determining compliance to the diameter tolerances, the pipe diameter is defined as the circumference of the pipe in any circumferential plane divided by Pi (π).
 e Out-of-roundness tolerances apply to maximum and minimum diameters as (New) measured with bar gage, caliper, or device measuring actual, maximum and minimum diameters.

9.11.3.2 In addition to API requirements, the wall thickness of each pipe shall be checked along the circumference at both ends and at the mid location of pipe body at 120' clock, 3 0' clock, 6 0' clock and 9 0' clock positions. The tolerances for wall thickness shall be as given in Table 11 of this specification.

Table 11 of API Spec 5L stands replaced by Table 11 of this specification.

Table 11- Tolerances for wall thickness

| Wall thickness (mm) | Tolerances c, d (mm) |
|---|----------------------|
| $t < 15.0$ mm | +0.20 t -0.0t |
| $t \geq 15.0$ mm | +3.0 mm -0.0 mm |
| a Deleted b Deleted c The + ve tolerance for wall thickness does not apply to the weld area. d See 9.13.2 of API Spec 5L and as modified herein for additional restrictions. | |

9.11.3.3 All pipes shall be supplied with length between 11.5 m and 12.5 m. However, pipe with length between 10.0 m and 11.5 m can also be accepted for a maximum of 5% of the ordered quantity. The minimum average length of the entire ordered quantity in any case shall be 12.0 m. Overall length tolerance shall be (-) Zero and (+) One pipe length to complete the ordered quantity. Table 12 of API Spec 5L stands deleted.

9.11.3.4 The tolerances for straightness shall be as follows:

- a) The total deviation from a straight line over the entire pipe length shall not exceed 12 mm, as shown in Figure I of API Spec 5L.
- b) The local deviation from straight line in 1.0 m (3.0 ft) portion at each pipe end shall be ≤ 3.0 mm (0.120 in), as shown in Figure 2 of API Spec 5L.

9.12 FINISH OF PIPE ENDS

9.12.5 Plain ends

9.12.5.6

(New) During removal of inside burrs at the pipe ends, care shall be taken not to remove excess metal and not to form an inside cavity on bevel. Removal of excess metal beyond the minimum wall thickness as indicated in clause 9.11.3.2 of this specification shall be a cause for re-bevelling. In case root face of bevel is less than that specified, the pipe ends shall be re-bevelled and rectification by filing or grinding shall not be done.

9.12.5.7

(New) Bevel Protectors

| | | | |
|---|---|----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 10 of 30 | |

Both pipe end of each pipe shall be provided with metallic or high impact plastic bevel protectors as per Manufacturer's standard. Bevel protectors shall be of a design such that they can be re-used by coating applicator for providing on externally anti-corrosion coated pipes after coating of line pipe.

9.16

(New) Reverse Bend Test

All pipes shall meet the minimum acceptance criteria for Reverse Bend Test as follows:

A specimen which fractures completely prior to the engagement of mandrel and specimen as specified in clause 10.2.4.9 (New) of this specification, or which reveals cracks or ruptures in the weld or heat affected zone longer than 4 mm shall be rejected. Cracks less than 6 mm long at the edges of the specimen shall not be cause for rejection. Dye penetrant testing shall be used to positively confirm cracks or openings.

10 INSPECTION

10.1 TYPES OF INSPECTION AND INSPECTION DOCUMENTS

10.1.3 Inspection documents for PSL 2 pipes

10.1.3.1 Inspection certificate 3.2 in accordance with EN 10204 shall be issued for each dispatched pipe by Purchaser's authorized representative.

10.2 SPECIFIC INSPECTION

10.2.1 Inspection frequency

10.2.1.2 For PSL 2 pipe, the inspection frequency shall be as given in Table 18 of this specification.

Table 18 of API Spec 5L stands replaced by Table 18 of this specification.

Table 18 - Inspection frequency of pipe

| Sl. no. | Type of inspection | Frequency of inspection |
|---------|---|---|
| 1 | Heat analysis ^a | One analysis per heat of steel |
| 2 | Product analysis ^b | Two pipes per lot (maximum 100 pipes) per heat |
| 3 | Tensile testing of the pipe body | Two pipes per test unit of not more than 100 pipes per heat |
| 4 | Tensile testing of the Two pipes per test unit of not more than longitudinal weld seam of pipe ^c | Two pipes per test unit of not more 100 pipes per heat |
| 5 | CVN impact testing of the pipe body | Once per test unit of not more than 50 pipes |
| 6 | CVN impact testing of the weld and HAZ of pipe | Once per test unit of not more than 50 pipes |
| 7 | Flattening test of pipe | As shown in Figure 6 a) of API Spec 5L |

| | | | |
|---|---|----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | | 0 |
| | | Page 11 of 30 | |

| | | |
|--|--|--|
| 8 | Reverse Bend Test (New) | Same as Figure 6 a) of API Spec 5L |
| 9 | Hardness testing | Any hard spot exceeding 50 mm (2.0 in) in any direction |
| 10 | Hydrostatic testing | Each pipe |
| 11 | Weighing of pipe | Each pipe shall be measured and recorded |
| 12 | Wall thickness measurement ^d | Each pipe |
| 13 | Pipe diameter and out-of roundness ^d | Each pipe |
| 14 | Length | Each length of pipe shall be measured and recorded |
| 15 | Straightness ^d | Each pipe |
| 16 | Tolerances for the weld seam ^d a) Radial offset of coil edges b) Height of flash and c) Depth of groove after trimming of inside flash | Each pipe |
| 17 | Visual inspection | Each pipe |
| 18 | Metallographic testing (including Vicker's hardness test) of the longitudinal seam weld of pipe as defined in clause 10.2.5 of this specification | At least one finished pipe from each lot of 50 pipes per heat or at least once per operating shift (12 hrs max.) whichever is occurring more frequently and whenever changes of grade, diameter or wall thickness are made and whenever significant excursions from operating heat treatment conditions are encountered and at the beginning of the production of each combination of specified outside diameter and specified wall thickness. |
| 19 | Other dimensional testing | Random testing, with the details left to the discretion of the manufacturer |
| 20 | Non-destructive inspection | In accordance with Annex E of API Spec 5L and as modified herein |
| <p>a Where the steel mill is not a part of an integrated pipe mill, heat analysis shall be reported by the Manufacturer prior to start of pipe production.</p> <p>b Pipes selected shall be such that one at the beginning of the heat and one at the end of the heat are also represented.</p> <p>c Pipe produced by each welding machine shall be tested at least once per week.</p> | | |

d Measurement shall be recorded at least 3 times per operating shift (12 hrs maximum).
 e "Test unit" is as defined in clause 4.62 of API Spec 5L.

10.2.2 Samples and test pieces for product analysis

Samples shall be taken, and test pieces prepared, in accordance with ISO 14284 or ASTM E1806. Samples used for product analysis shall be taken from finished pipes only.

Samples for product analysis from coil may be used provided the traceability of samples is guaranteed.

10.2.3 Samples and test pieces for mechanical tests

10.2.3.1 General

In addition to API Spec 5L requirements, samples and test pieces for various types of tests shall be taken from Figure 5 b) and Figure 6 a) of API Spec 5L and Figure 10.2.4.9.1 & 10.2.5.3.2 of this specification, whichever is applicable, and as given in Table 20 of this specification.

Table 20 of API Spec 5L stands replaced by Table 20 of this specification.

| Sample Location | Type of test | Number, Orientation and location of test pieces per sample a | |
|--------------------|--------------|--|-----------------|
| | | Specified outside diameter, D mm (in) < 219.1 mm (8.625 in) ~ 219.1 mm (8.625 in) | |
| Pipe body | Tensile | 1 L90 | 1T180 |
| | CVN | 3T90 | 3T90 |
| Seam Weld | Tensile | --- | 1W ^b |
| | CVN | 3W and 3HAZ | 3W and 3HAZ |
| | Hardness | 1W (As shown in figure 10.2.5.3 of this specification) | |
| Pipe body and weld | Flattening | As shown in figure 6 a) of API Spec 5L | |
| | Reverse Bend | As shown in figure 10.2.4.9.1 of this specification | |

A See figure 5 (b) of API Spec 5L for an explanation of the symbols used to designate orientation and location.

B Test specimen shall be tested for ultimate tensile strength only.

| | | | |
|---|---|----------------|-----|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 13 of 30 | |

10.2.3.2 Test pieces for the tensile test

Rectangular test pieces, representing the full wall thickness of the pipe, shall be taken in accordance with ASTM A 370 and as shown in Figure 5 b) of API Spec 5L.

Longitudinal tensile tests for pipe body with specified outside diameter, $D < 219.1$ mm (8.625 inch) shall be carried out on a strip specimen representing full wall thickness of the pipe prepared according to ASTM A370.

Transverse tensile test for pipe body with specified outside diameter, $D \sim 219.1$ mm (8.625 inch) shall be carried out on flattened rectangular test pieces.

For tensile test piece, both inside and outside flash of weld in excess of pipe wall thickness shall be removed from the test piece either by grinding or machining.

10.2.3.3 Test pieces for the CVN impact test

In addition to the API Spec 5L requirements, following shall also be applicable:

The test pieces shall be prepared in accordance with ASTM A370. Non-flattened test pieces shall be used. The axis of the notch shall be perpendicular to the pipe surface.

Charpy V-notch impact testing shall be performed on full-sized test pieces. However, if preparation of full-size test piece is not possible, then standard sub-sized test pieces shall be prepared as per ASTM A370.

Lower pipe sizes wherein preparation of transverse sub-sized specimen is not possible, CVN impact testing shall be carried out on longitudinal test specimen [see Note 'a' of Table 8 of this specification].

10.2.3.7 Test pieces for flattening test

The test pieces shall be prepared in accordance with ISO 8492. The length of each test piece shall be ≥ 60 mm.

Minor surface imperfections may be removed by grinding.

10.2.3.8 Test pieces for Macro graphic and metallographic tests

(New) Test piece for metallographic testing shall be taken transverse to the longitudinal weld seam as indicated in Figure 10.2.5.3 of this specification. The test piece shall be suitably ground, polished and etched to reveal the macro-structure.

10.2.3.9 Test pieces for Reverse bend test

(New) Ring specimen of width between 100 mm to 115 mm shall be taken from the pipe. Reverse bend test shall be carried out as per clause 10.2.4.9 (New) of this specification.

10.2.4 Test methods

10.2.4.3 CVN impact test

The Charpy test shall be carried out in accordance with ASTM A370.

10.2.4.7 Flattening test

In addition to the API Spec 5L requirements, following shall also be applicable:

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 14 of 30 | |

The flattening test shall be carried out in accordance with ISO 8492.

10.2.4.9 Reverse bend test

(New) The mandrel shall be plunged into the test piece prepared in accordance with clause 10.2.3.9 (New) of this specification, with the weld in contact with the mandrel, to such a depth that the angle of engagement between mandrel and specimen reaches 60° as shown in figure 10.2.4.9.1 of this specification. If the combination of diameter & wall thickness of pipe and radius of mandrel is such that the angle of engagement cannot reach 60°, then the mandrel shall be plunged into the specimen until opposite walls of the specimen meet.

Selection of Mandrel

The reverse bend test shall be carried out with a mandrel, whose radius (R), or width (A) shall be calculated for any combination of diameter, wall thickness and grade with the following formula:

$$A=2R = \frac{1.4(D-t)t}{e(D-2t)-1.4t}$$

Where,

- D - Specified outside diameter of pipe, mm
- t - Specified wall thickness of pipe, mm
- 1.4 - Peaking factor
- e - Strain

Minimum value of 'e' shall be as per Table 23 of API Spec 5L reproduced as below:

| Pipe grade | Strain value 'e' |
|------------|------------------|
| Gr. B | 0.1375 |
| X42 | 0.1375 |
| X46 | 0.1325 |
| X52 | 0.1250 |
| X56 | 0.1175 |
| X60 | 0.1125 |
| X65 | 0.1100 |
| X70 | 0.1025 |

10.2.5 Macro graphic and metallographic tests

10.2.5.3 The test piece shall be visually examined using a minimum 40X magnification to provide evidence that heat treatment of weld zone is adequate and there is no untempered martensite or detrimental oxides from the welding process present along the weld seam. The metallographic examination shall be documented on micrographs (at 10X to 20X

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 15 of 30 | |

magnification). In case imperfections or defects are observed, it will become a cause for re- evaluation of welding parameters and heat treatment as deemed necessary by Purchaser's Representative.

Vickers hardness tests shall be carried out on each test piece taken for metallographic examination in accordance with ISO 6507-1, at locations indicated in Fig. 10.2.5.3 of this specification. Indentation in the HAZ shall start as close to the fusion line as possible. The resulting Vickers hardness value at any point shall not exceed 248HV 10. The maximum difference in hardness between the base metal and any reading taken on the weld or heat affected zone shall be less than 80HV 10. Modalities of retest shall be in accordance with clause 10.2.12.7 of API Spec 5L.

10.2.6 Hydrostatic test

10.2.6.1 Test pressure shall be held for a minimum period of 15 seconds for all sizes and grades of pipes.

10.2.6.2 In addition to the requirements of API Spec 5L, following shall also be applicable:

The pressure gauge used for hydrostatic testing shall have a minimum range of 1.5 times and maximum range of 4 times the test pressure. The test-pressure measuring device shall be calibrated by means of a dead-weight tester only. The test configuration shall permit bleeding of trapped air prior to pressurization of the pipe.

10.2.6.5 The test pressure for all sizes and grades of pipe shall be such that hoop stress (fibre stress) generated is at least 95% of SMYS, computed based on the Equation (6) indicated in clause 10.2.6.5 of API Spec 5L. Table 26 of API Spec 5L stands deleted.

10.2.7 Visual inspection

10.2.7.1 Each pipe shall be visually examined for entire external surface and internal surface to the extent feasible and shall be free of defects in finished condition. Visual examination shall be carried out in a sufficiently illuminated area; minimum 1000 1x. If required additional lights shall be used to obtain good contrast and relief effect between imperfections and backgrounds.

10.2.8 Dimensional Checking

10.2.8.1 Diameter measurements shall be made with a circumferential tape only.

10.2.8.7 The measuring equipment requiring calibration or verification under the provisions of API Spec 5L shall be calibrated with manual instruments at least once per operating shift (12 hours maximum). Such calibration records shall be furnished to Purchaser's Representative on request.

10.2.10 Non-destructive inspection

Non-destructive inspection shall be performed in accordance with Annex E of API Spec 5L and as modified herein.

10.2.11 Reprocessing

This clause of API Spec 5L stands cancelled.

10.2.12 Retesting

10.2.12.1 Recheck analyses

| | | | |
|---|---|---------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 16 of 30 | |

Modalities of recheck analysis shall be as per API Spec 5L as applicable to the lot being tested (see Table 18 of this specification). However, during individual testing, each pipe shall be fully analysed to meet the requirements of Table 5 of this specification.

10.2.12.9 Reverse bend retests

(New) Reverse bend retest provisions shall be same as specified for flattening retests in clause 10.2.12.3 of API Spec 5L.

11 MARKING

11.1 GENERAL

11.1.1 Pipe manufactured in accordance with this specification shall be marked by the manufacturer as per the requirements of API Spec 5L and as modified herein. Marking shall be in English language and International System (SI) of Units.

11.1.5 Marking shall also include Purchase Order number, item number, pipe number (New) and heat number.

11.2 Pipe markings

11.2.1 k) (New) Actual length in metres and actual pipe weight in kg shall be marked

11.2.2 c) (New) Paint used for stencil marking shall withstand a temperature (New) up to 250°C expected to be experienced during further external anti-corrosion coating operations of line pipe by coating applicator.

11.2.3 The pipe number shall be placed by cold rolling or low stress dot marking or vibro-etching on the outside surface of the pipe at an approximate distance of 50 mm from both ends. In case of non-availability of either cold rolling or low stress dot marking facility in pipe mill, an alternative marking scheme of a permanent nature may be proposed by the Manufacturer

11.2.7 A colour code band shall be marked on inside surface of finished pipe for identification of pipes of same diameter but different wall thickness, as indicated in the Purchase Order.

The colour code band shall be 50 mm wide and shall be marked at a distance of 150 mm from the pipe ends.

12 COATINGS AND THREAD PROTECTORS

12.1.1 Unless otherwise specified in the Purchase Order, the pipes shall be delivered bare, free of any trace of oil, stain, grease and paint. Varnish coating shall be applied on the marking area.

Bevels shall be free of any coating.

13 RETENTION OF RECORDS

In addition to the records indicated in API Spec 5L, the Manufacturer shall retain the records of all additional tests and calibration records mentioned in this specification including the hard copy records of ultrasonic testing carried out on pipe/coil as well as pipe ends.

| | | | |
|---|---|---------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 17 of 30 | |

14 PRODUCTION REPORT

(New) The Manufacturer shall provide one electronic copy and six hard copies of production report in English language indicating at least the following for each pipe. International system of units (SI) shall be adopted.

- Pipe number
- Heat number from which pipe is produced
- Pipe length and weight
- Pipe grade

The Manufacturer shall provide one electronic copy and six hard copies of acceptance certificates which shall include the results of all tests required as per this specification and performed on delivered material giving details of, but not limited to, the following:

- All test certificates as per clause 10.1.3 of API Spec 5L and as modified herein.
- Records of qualification of welders and procedures for repair welding.
- Certified reports of dimensional inspection, surface imperfections & defects.
- Data on test failures, rejected heats/lots, etc.
- All other reports and results required as per this specification.

The certificates shall be valid only when signed by the Purchaser's Representative. Only those pipes, which have been certified by the Purchaser's Representative, shall be dispatched from the pipe mill.

In the event of small quantities of pipes supplied against this specification, the production report may consist of only test certificates required as per clause 10.1.3 of API Spec 5L and as modified herein and other test reports/results required as per this specification.

15 INSPECTION OF FIELD TESTS & WARRANTY

(New) Purchaser shall be reimbursed by Manufacturer for any pipe furnished on this order that fails under field hydrostatic test if such failure is caused by a material/ manufacturing defect in the pipe. The reimbursement cost shall include pipe, labour and equipment rental for finding, excavating, cutting out and installation of replaced pipe in position. The field hydrostatic test pressure will not exceed that value which will cause a calculated hoop stress equivalent to 95 percent of specified minimum yield strength.

In case Manufacturer so desires, he will be advised at least two weeks in advance so that his Representative may witness the hydrostatic test in field, however, the testing and leak (if any) finding and repair operation shall not be postponed because of absence of the Manufacturer's Representative.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 18 of 30 | |

Annex B

Manufacturing Procedure Qualification for PSL 2 Pipe

B.1 INTRODUCTION

B.1.1 This annex specifies additional provisions that apply for the PSL 2 pipes ordered as per this specification.

B.1.2 Two lengths each of completely finished pipes from two different heats (i.e. a total of four pipe lengths) shall be selected at random for testing as per clause B.5.1 of this specification to verify that the manufacturing procedure results in the quality of pipes which are in complete compliance with this specification. The pipes thus tested shall be considered to be the test pipes required per heat or per lot as per relevant clauses of this specification.

These manufacturing procedure qualification tests (MPQT) shall be repeated upon any change in the manufacturing procedure as deemed necessary by Purchaser's Representative. The manufacturing procedure qualification tests shall be carried out on pipes for each wall thickness, each diameter, and each grade of steel.

B.1.3 Verification of the manufacturing procedure shall be by qualification in accordance with clause B.3, B.4 and B.5 of API Spec 5L and as modified herein.

Note: In the event of small quantities of pipes ordered against this specification, like those for bends and other similar applications, as specifically called out in the Purchase Order, the manufacturing procedure qualification test as per clause B.5.1 of this specification shall not be carried out. Pipes in such case shall be accepted based on regular production tests.

B.3 CHARACTERISTICS OF THE MANUFACTURING PROCEDURE SPECIFICATION

Before pipe production commences, Manufacturing Procedure Specification (MPS) for manufacturing of pipes and Statistical process control charts shall be prepared by pipe manufacturer (including all information as per clause B.3 a), b) and e) of API Spec 5L) and submitted for approval of the Purchaser.

B.5 MANUFACTURING PROCEDURE QUALIFICATION TESTS (MPQT)

B.5.1 For the qualification of the manufacturing procedure, all tests & inspections specified in Table 18 and clause B.5.2 of this specification shall be conducted on all the pipes selected for testing as per clause 8.1.2 of this specification.

B.5.2 The Manufacturer shall submit to Purchaser a report giving the results of all tests mentioned below. The report shall be agreed and signed by Purchaser's Representative, prior to start of regular production.

The various tests to be conducted on each pipe shall be as follows. The test method and acceptance values shall be as per this specification unless specified differently in this Annex.

a. **Visual Examination**

All pipes shall be examined visually for dimensional tolerances and apparent surface defects.

b. **Ultrasonic Examination**

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 19 of 30 | |

The weld seam of all pipes shall be examined ultrasonically by automatic ultrasonic equipment.

c. Mechanical Properties

The mechanical properties of all pipes shall be tested and shall meet the requirements of this specification. Purchaser's Representative will select the places in pipe from where the test pieces shall be extracted.

The following tests shall be conducted:

i. Flattening test

Two (2) flattening test pieces shall be extracted; one test piece shall be tested with weld at 0° and other at 90°.

ii. Tensile test

Tensile tests shall be conducted on:

For pipe with specified outside diameter, $D < 219.1$ mm (8.625 inch):

- Two (2) longitudinal test pieces from base metal

For pipe with specified outside diameter, $D \sim 219.1$ mm (8.625 inch):

- Two (2) transverse test pieces from base metal
- Two (2) transverse test pieces from the longitudinal weld

seam iii. Metallographic tests

Six (6) weld cross-section test pieces, three (3) from each end of pipe weld seam shall be taken for metallographic examination. Two of these shall be tested for hardness at room temperature after etching.

iv. CVN impact testing

CVN impact test shall be performed on test pieces extracted as follows:

- Four sets of three (3) transverse test pieces each from base metal
- One set of three (3) transverse test pieces with weld in middle
- One set of three (3) transverse test pieces with HAZ in middle

The minimum average (set of three test pieces) absorbed energy value (KvT) at the test temperature specified in clause 9.8 and Table 8 of this specification shall be complied with for test pieces extracted from base metal, weld and HAZ.

v. Fracture toughness testing

Four (4) sets of CVN base metal test pieces shall be tested at - 40°C, - 10°C, 0°C and + 20° C for shear area and absorbed energy to produce full transition curve. The minimum average (set of three test pieces) shear fracture area at the test temperature specified in clause 9.8 of this specification shall be complied with. For other temperatures, the value shall be for information only.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 20 of 30 | |

Annex C

Treatment of surface imperfections and defects

C.1 TREATMENT OF SURFACE IMPERFECTIONS

Surface imperfection not classified as defect as per this specification shall be cosmetically dressed-out by grinding.

C.2 TREATMENT OF DRESSABLE SURFACE DEFECTS

C.2.3 Complete removal of defects shall be verified by local visual inspection and by suitable non-destructive inspection. To be acceptable, the wall thickness in the ground area shall be in accordance with clause 9.11.3.2 of this specification.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 21 of 30 | |

Annex E

Non-destructive inspection for other than sour service or offshore service

The Purchaser reserves the right to depute its Representative(s) to perform inspection and witness tests in all phases of manufacturing and testing starting from steelmaking to finished line pipe ready for shipment. Manufacturer shall comply with the provisions regarding inspection notice, plant access, compliance and rejection mentioned in the Annex Q (New) of this specification. The Manufacturer shall give the Purchaser reasonable notice of the starting date of normal production and the work schedule. Any action or omission on part of Purchaser's Representative shall not relieve the Manufacturer of his responsibility and obligation to supply material in strict accordance with this specification.

E.1 QUALIFICATION OF PERSONNEL

E.1.1 All personnel performing NDT activities shall be qualified in the technique applied, in accordance with latest edition of ISO 9712, ISO 11484 or ASNT No. ASNT-TC-1A or equivalent.

All NDT shall be performed in accordance with written procedures. These procedures shall have prior approval of the Purchaser.

Inspector Qualification

Acceptable qualification for NDT inspectors shall be as specified below:

(i) For UT

For UT, at least one Level III qualified inspector shall be available to the mill for overall supervision. Level III inspectors shall be ASNT Level III or ACCP Professional Level III and certified in applicable method.

A level II inspector is required for shift supervision, manual weld inspection and calibration of all systems (both manual and automated).

(ii) For all other NDT methods

Evaluation of indications Level II & Level III inspector

E.3 METHODS OF INSPECTION

E.3.1 General

E.3.1.1 The electric weld of the pipe shall be inspected by ultrasonic methods (Refer Table E.1 of API Spec 5L) for full length (100%) for the entire thickness, using automatic ultrasonic equipment in accordance with clause E.5 of API Spec 5L and as modified in this specification.

E.3.1.3 Location of NDT equipment in the manufacturer's facility shall be such that final inspection of weld seam of pipe shall be performed after hydrostatic testing.

E.3.2 Pipe End Inspection - Welded Pipe

E.3.2.1 Pipe ends including weld at the pipe ends not covered by automatic ultrasonic equipment shall be inspected by manual ultrasonic equipment with same sensitivity and capability as automatic equipment, or, such non-inspected pipe end shall be cut-off. Records in accordance with E.5.4 of API Spec 5L shall be maintained.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 22 of 30 | |

E.3.2.3 Ultrasonic inspection in accordance with the method described in ISO 10893-8 shall be used to verify that the 50 mm (2.0 inch) wide zone at each pipe end is free of any laminar imperfections in the circumferential direction.

E.3.2.4 Bevel face of each pipe end shall be magnetic particle inspected for the detection (New) of laminar imperfections in accordance with ISO 10893-S

E.5 ULTRASONIC AND ELECTROMAGNETIC INSPECTION

E.5.1.1 In addition to the API Spec 5L requirements, all automatic ultrasonic equipment shall have an alarm device, which continuously monitors the effectiveness of the coupling. The equipment for the automatic inspection shall allow the localization of both longitudinal and transverse defects corresponding to the signals exceeding the acceptance limits of the reference standard. The equipment shall be fitted with a paint spray or automatic marking device and alarm device for areas giving unacceptable ultrasonic indications. All ultrasonic testing equipment shall be provided with recording device. In addition, an automatic weld tracking system shall be provided for correct positioning of the probes with respect to weld centre.

E.5.2. Ultrasonic and electromagnetic inspection reference standards

E.5.2.1 The reference standard (calibration pipe) shall have the same specified diameter and wall thickness as specified for the production pipe being inspected.

E.5.2.2 Reference standards shall be of sufficient length to permit calibration of ultrasonic inspection equipment at the speed to be used in normal production.

The reference standard (calibration pipe) shall also be of the same material, type and have the same surface finish and heat treatment as the pipe being inspected.

E.5.2.3 Reference standards

E.5.2.3.1 Reference standards for pipe weld UT:

(New) Reference standard shall contain as reference indicators i.e. machined notches as given in

Table E.7 of this specification

Table E.7 of API Spec 5L stands replaced by Table E.7 of this specification.

| ITEM | Reference indicators | | |
|-----------|--|----|-------------------------|
| | Number of notches and orientation ^a | | Notch Type ^b |
| | OD | ID | |
| Weld Seam | IL | IL | N10 |

a The symbol indicates the orientation of the notch i.e. L = Longitudinal. Reference indicators shall be located as per Figure E.1 of this specification.

b Dimensions of Notch type N10 shall be 0.1 t x 50 mm x 1 mm (Depth x maximum Length x maximum width), where, 't' is the specified wall thickness. The depth tolerance is ± 15% of the specified notch depth or ± 0.05 mm, whichever is greater.

| | | | |
|---|---|----------------|-----|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 23 of 30 | |

E.5.2.3.2 Reference standards for coil pipe body UT:

(New) Reference standard for the ultrasonic inspection of coil or pipe body (except the coil edges/pipe ends) shall contain continuous machined notch of following dimension:

a) width, w : 8 mm, with a tolerance $+0.8/ - 0.0$ mm

b) depth, d : $0.25 t < d < 0.5 t$, where 't' is the specified wall thickness

Reference standard for the ultrasonic inspection of coil edges (area adjoining weld seam)/ pipe ends shall have 6.4 mm (1/4 inch) diameter FBH of a depth $0.5 t$, where 't' is the specified wall thickness.

E.5.3 Instrument standardization

E.5.3.2 The instrument shall be calibrated with appropriate reference standard (refer E.5.2 of API Spec 5L and as modified herein) at following intervals:

- Once at the beginning of each operating shift (12 hours maximum).
- Once in between of each operating shift i.e, 3 hrs to 4 hrs after the first
- Every time there is change in probes or working condition of the UT machine.
- Every time the running of the system gives rise to doubts on its efficiency.

If during the above calibration verification, it is found that the equipment has not functioned satisfactorily in the opinion of the Purchaser's Representative, all the pipes or coils already inspected after the previous verification shall be inspected again at Manufacturer's cost.

E.5.5 Acceptance limits

E.5.5.2 For ultrasonic inspection of pipe/coil, any imperfection that produces an imperfection greater than the acceptable limits shall be treated as following:

a) Locations showing indications above the acceptance limits during automatic ultrasonic inspection may be re-examined by manual ultrasonic method. If no defects are located during re-examination, the original findings may be ignored. Additional scanning may be requested by Purchaser's Representative to check questionable areas.

E.5.6 Disposition of defects found by ultrasonic and electromagnetic inspection

Disposition of any imperfection in pipe/coil that produces an indication greater than the acceptable limits as specified in Table E.9 (New) of this specification shall be classified as defect and shall be given disposition as specified in (e) or (f) of E.10 of API Spec 5L.

E.7 RESIDUAL MAGNETISM

E.7.2 The longitudinal magnetic field shall be measured on all sizes of pipes. Measurement on pipe in stack shall not be considered valid. Such measurements shall be taken on the root face or square cut face of finished plain-end pipes.

E.7.3 Measurements shall be made using Hall - effect gaussmeter only.

E.7.4 Measurements shall be made on each end of a pipe for 5% of the pipes produced but at least once per 4 hr per operating shift (12 hrs maximum).

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 24 of 30 | |

E.7.6 Four readings shall be taken approximately 90° apart around the circumference of each end of the pipe. The average of the four readings shall not exceed 2.0 mT (20 gauss) and no single reading shall exceed 2.5 mT (25 gauss). All residual magnetism measurements shall be recorded.

E.8 LAMINAR IMPERFECTIONS IN THE PIPE BODY OF EW, SAW AND COW

PIPES

E.8.1 The coil, except the longitudinal coil edges (area adjoining weld seam), shall be ultrasonically tested for laminations using an oscillating or straight running pattern of probes in accordance with ISO 10893-9 amended as follows:

The distance between adjacent scanning tracks shall be sufficiently small to ensure detection of minimum allowed imperfection size. The minimum coverage during automatic ultrasonic inspection shall be $\geq 20\%$ of the coil surface uniformly spread over the area.

Acceptance limit for laminar imperfection in the coil, except the longitudinal edges, shall be as per Table E.9 (New) of this specification. Disposition of defects shall be as per clause E.5.6 of this specification.

Table 3 of ISO 10893-9 stands replaced by Table E.9 (New) of this specification.

E.9 LAMIMAR IMPERFECTIONS ALONG THE STRIP! PLATE EDGES OR PIPE WELD SEAM OF EW, SAW AND COW PIPES

The longitudinal edges of the coil (area adjoining weld seam) shall be 100% ultrasonically inspected in accordance with ISO 10893-9 amended as follows:

UT shall be performed over 25 mm wide zone along each side of the trimmed longitudinal edges of the coil.

Acceptance limit for laminar imperfection in the longitudinal edges of the coil shall be as per Table E.9 (New) of this specification. Disposition of defects shall be as per clause E.5.6 of this specification.

Table 2 of ISO 10893-9 stands replaced by Table E.9 (New) of this specification.

Table E.9 - Acceptance criteria for laminar imperfection in coil/ pipe body (New)

| Location | Maximum individual imperfection | | Minimum imperfection size considered | | | Maximum population density |
|-------------------------------------|---------------------------------|------------------|--------------------------------------|-----------|----------|----------------------------|
| | Area mm ² | Length mm | Area mm ² | Length mm | Width mm | |
| Coil, except the longitudinal edges | 1000 | 100 ⁴ | 300 | 35 | 8 | 100 (per 1.0 m x 1.0m) |
| Longitudinal edges of the coil | 500 | 40 | ---- | 20 | -- | 4 (per 1.0 m length) |

a Number of imperfections of size smaller than the maximum imperfection size and greater



than the minimum imperfection size.

b Length is the dimension at right angles to the scan track.

c Width is the dimension parallel to the scan track.

d Any planar imperfection which is not parallel to the coil surface is not acceptable.

e For an imperfection to be larger than the minimum imperfection size, the minimum area, minimum length and minimum width given for the coil/ pipe body, all have to be exceeded.

E.10 DISPOSITION OF PIPES CONTAINING DEFECTS

c) The repaired area shall be 100% rechecked by magnetic particle or ultrasonic inspection to ensure complete removal of defects. However, for repair of cosmetic type of defects, MPI may not be conducted if so, directed by Purchaser's Representative on case to case basis. The pipes having a thickness less than the minimum allowed in accordance with this specification, after repair by grinding shall be treated for disposition in accordance with (e) or (f) of clause E.10 of API Spec 5L.

E.11 ROTARY ULTRASONIC INSPECTION OF PIPE (ALTERNATIVE METHOD)

(New) As an alternative, full pipe may be ultrasonically inspected after welding of longitudinal seam by rotary ultrasonic testing method (pipe in rotating condition) in accordance with ISO 10893-8 amended as follows:

The coverage area during ultrasonic inspection shall be 100 % of the pipe body including weld seam, sides of the weld seam and pipe ends.

The reference standard for the weld seam as per clause E.5.2.3.1 and Table E.7 of this specification shall be used for the rotary ultrasonic testing.

If the manufacturer opts for rotary ultrasonic testing of full pipe in accordance with this clause, then, the requirement for ultrasonic inspection as per clause E.3.1.1, E.3.2.3, E.8 and E.9 of API Spec 5L and as modified herein shall not be applicable.

| | | | |
|---|---|--|----------------------------------|
|  | <p align="center">STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE</p> | <p align="center">Document No.</p> | <p align="center">Rev</p> |
| | | <p align="center">HOGPL-PL-00001</p> | <p align="center">0</p> |
| | | <p align="center">Page 26 of 30</p> | |

Annex Q (New)

Purchaser Inspection

Q.1 INSPECTION NOTICE

Advance notice shall be given by the manufacturer prior to the start of production to the purchaser to inspect/witness the manufacturing activities including tests.

Q.2 PLANT ACCESS

The inspector representing the purchaser shall have unrestricted access, always while work of the contract of the purchaser is being performed, to all parts of the manufacturer's works that will concern the manufacture of the pipe ordered. The manufacturer shall afford the inspector all reasonable facilities to satisfy the inspector that the pipe is being manufactured in accordance with this specification. All inspections should be made at the place of manufacture prior to shipment, unless otherwise specified on the purchase order, and shall be so conducted as not to interfere unnecessarily with the operation of the works.

Q.3 COMPLIANCE

The manufacturer is responsible for complying with all the provisions of this specification. The purchaser may make any investigation necessary to be satisfied of compliance by the manufacturer and may reject any material that does not comply with this specification.

Q.4 REJECTION

If the Purchaser Representative rejects pipes repeatedly for any recurring cause, this shall be adequate reason to refuse final inspection of subsequent pipes until the cause has been investigated and corrective action taken by the Manufacturer.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 27 of 30 | |


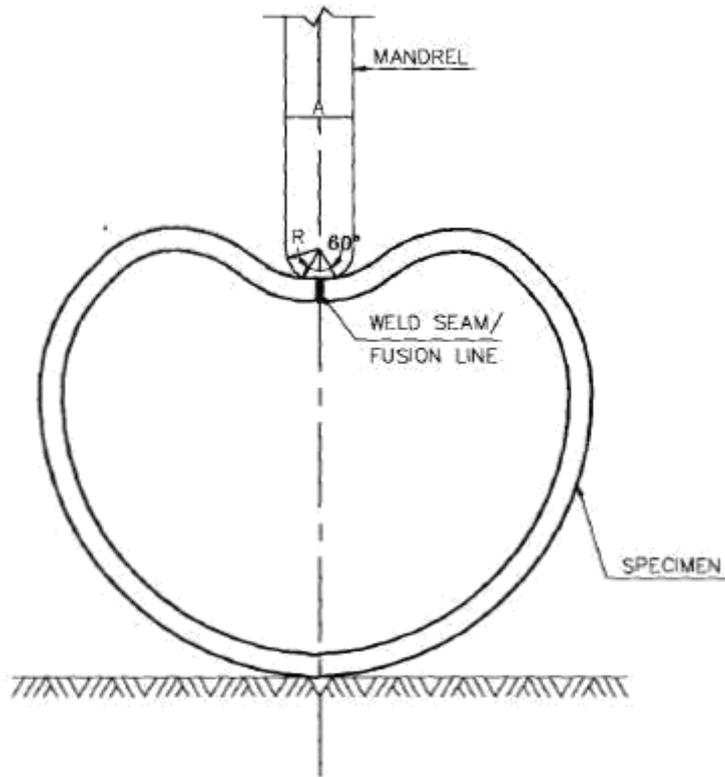


FIGURE: 10.2.4.9.1
REVERSE BEND TEST

| | | | |
|---|--|----------------|-----|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 28 of 30 | |

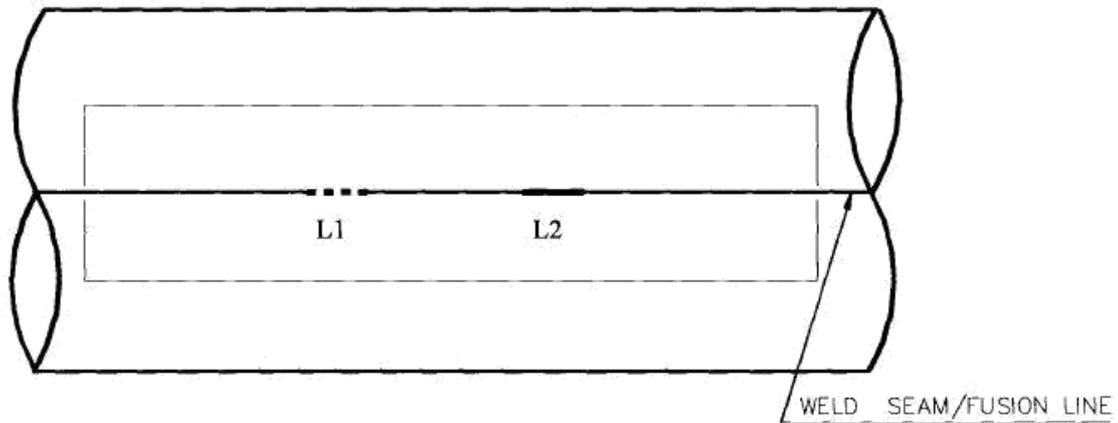

- L1 - Longitudinal inside notch (N10) at weld line
- L2 - Longitudinal outside notch (N10) at weld line

FIGURE: E.1

REFERENCE STANDARD FOR UT OF LONGITUDINAL WELD SEAM

| | | | |
|---|---|----------------|-----|
|  | STANDARD SPECIFICATION FOR HIGH FREQUENCY WELDED LINE PIPE | Document No. | Rev |
| | | HOGPL-PL-00001 | 0 |
| | | Page 30 of 30 | |



**STANDARD SPECIFICATION
FOR
3 LAYER POLYTHYLENE COATING OF LINEPIPES**

| | | | | |
|--------------------|-------|----|---------------------|----|
| | | | TOTAL SHEETS | 26 |
| DOCUMENT NO | HOGPL | PL | 0000 3 | |

**STANDARD SPECIFICATION
FOR
3 LAYER POLYTHYLENE COATING OF LINEPIPES**

| REV | DATE | DESCRIPTION | PREP | CHK | APPR |
|-----|------------|----------------------------------|------|-----|------|
| 0 | 18.05.2021 | ISSUED AS STANDARD SPECIFICATION | | | |

ABBREVIATIONS:

| | |
|------|--|
| ASME | American Society of Mechanical Engineers |
| ASTM | American Society of Testing of Materials |
| API | American Petroleum Institute |
| OISD | Oil Industry Safety Directorate |



**STANDARD SPECIFICATION FOR 3 LAYER
POLYTHYLENE COATING OF LINEPIPES**

Document No.

Rev

SS-PL-003

0

Page 2 of 26

CONTENTS

| | |
|---|----|
| 1.0 SCOPE..... | 4 |
| 2.0 REFERENCE DOCUMENTS..... | 4 |
| 3.0 MATERIAL REQUIREMENTS..... | 5 |
| 4.0 COATING APPLICATION..... | 9 |
| 5.0 INSPECTION AND TESTING..... | 15 |
| 6.0 HANDLING, TRANSPORTATION AND STORAGE..... | 21 |
| 7.0 REPAIR OF COATING AND FINAL ACCEPTANCE..... | 23 |
| 8.0 MARKING AND PIPE IDENTIFICATION..... | 24 |
| 9.0 PRODUCTION REPORT..... | 24 |
| 10.0 QUALITY ASSURANCE..... | 25 |

1.0 SCOPE

This Specification covers the minimum requirements for supply/arrangement of all materials, plant, equipment, plant sites, consumables, utilities and application including all labor, supervision, inspection and tests etc. for application of external anti-corrosion coating of pipes by using Three Layer Side Extruded Polyethylene coating conforming to DIN-30670, 1991,'Polyethylene Coating for Steel Pipes and Fittings' and the requirements of this specification.

2.0 REFERENCE DOCUMENTS

2.1. CODES AND STANDARD

Reference has also been made to the latest edition (edition enforce at the time of issue of enquiry unless otherwise specify) of the following Standards, Codes and Specifications. The edition enforces at the time of floating the enquiry shall be termed as latest edition.

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

| | |
|-------------|--|
| ASTM D-149 | Standard Test Methods of Dielectric Breakdown Voltage and Dielectric Strength of Solid Electrical Insulating Material at commercial frequencies. |
| ASTM D-257 | Standard Test Methods for D-C Resistance or Conductance of Insulating Materials |
| ASTM D-543 | Standard Method of Test for Resistance of Plastics to Chemical Reagents |
| ASTM D-570 | Standard Method of Test for Water Absorption of Plastics |
| ASTM D-638 | Standard Method of Test for Tensile Properties of Plastics |
| ASTM D-792 | Standard Test Method for Density and Specific Gravity (Relative Density) of Plastics by Displacement |
| ASTM D-1238 | Test Method for Flow Rates of Thermoplastics by Extrusion |
| ASTM D-1525 | Test Method for Vicat Softening Temperature of Plastics |
| ASTM D-1603 | Test Method for Carbon Black in Olefin Plastics |
| ASTM D-1693 | Test Method for Environmental Stress Cracking of Ethylene Plastics |
| ASTM D-2240 | Test Method for Rubber Property - Durometer Hardness |
| STM D-3895 | Test Method for Oxidative-Induction Time of Polyolefin by Differential Scanning Calorimetry |
| ASTM G-42 | Tentative Methods for Cathodic Disbonding of Pipeline coatings Subjected to Elevated or Cyclic Temperatures |

AMERICAN PETROLEUM INSTITUTE (API)

| | |
|-------------|---|
| API 5L | Specification for Line Pipe |
| API RP 5L 1 | Recommended Practice for Railroad Transportation of Line pipe |
| API RP 5LW | Transportation of Line Pipe on Barges and Marine Vessels |

DEUTSCHES INSTITUT FUR NORMUNG (DIN)

| | |
|--------------|---|
| DIN EN 10204 | Metallic Products - Types of Inspection Documents |
|--------------|---|



STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES

Document No.

Rev

HOGPL-PL-00003

0

Page 4 of 26

- DIN 53735 Testing of Plastics: Determination of Melt Index of Thermoplastics
 DIN 30670 Polyethylene Coating for Steel Pipes and Fittings

INTERNATIONAL STANDARD (IS)

- ISO 8502 - 3 Preparation of Steel Substrates before Application of Paints and Related Products part 3 - Assessment of Dust on Steel Surfaces Prepared for Painting (Pressure Sensitive Tape Method)
 ISO 11124 Preparation of Steel Substrates Before Application of Paints and Related Products

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

- ASME B31.8 Gas Transmission and Distribution Piping Systems. Liquid
 ASME B31.4 Transportation Systems for Hydrocarbons, Liquid, Petroleum Gas, Anhydrous Ammonia, and Alcohols

CANADIAN STANDARD ASSOCIATION (CSA)

- CSA Z245.20-2 External Fusion Bond Epoxy Coating for Steel Pipe

3.0 MATERIAL REQUIREMENTS

3.1. FUNCTIONAL REQUIREMENT

The three layer coating system shall comprise of a powder epoxy primer, polymeric adhesive and a polyethylene topcoat. Coating materials shall be suitable for the service conditions and the pipe sizes involved. The coating materials i.e. epoxy powder; adhesive and polyethylene compound shall have proven compatibility. The coating system and materials shall be pre-qualified and approved by Company in accordance with provisions of Annexure I of this specification. Contractor shall obtain prior approval from Company for the coating system and coating materials.

3.1.1 OPERATING TEMPERATURE

The coating must be able to withstand minimum and maximum continuous in-service operating temperatures of 0°C and (+) 65°C respectively and still comply with the performance requirements of this specification.

EXPOSURE TO ENVIRONMENT

The coating materials shall withstand exposure to ultraviolet radiation (i.e. sunlight) and heat due to exposure to sunlight with a daytime coating temperature of at least 80°C without impairing its serviceability and properties specified

3.2. PROPERTIES

3.2.1 GENERAL

The 3 Layer Polyethylene coating shall conform to DIN 30670, Type „S“ and the requirements of this specification.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 5 of 26 | |

3.2.2 FUSION BONDED EPOXY (FBE) POWDER

Epoxy powder shall comply Canadian Standard Association (CSA) Standard Z245.20-02. The color of epoxy powder shall be either green or dark red or any other color approved by Company except grey.

3.2.3 ADHESIVE

Co-polymer adhesive used shall be grafted type and the adhesive shall have the following properties:

| Sr. No. | Properties | Unit | Requirement | Test Method |
|---------|----------------------------------|--------------|-------------|-------------|
| a | Melt Flow Rate (190°C / 2.16 kg) | g/10 minutes | 1.0 min. | ASTM D 1238 |
| b | Vicat Softening Point | °C | 100 min. | ASTM D 1525 |
| c | Specific Gravity | - | 0.926 min | ASTM D 792 |

3.2.4 POLYETHYLENE COMPOUND

| Sr. No. | Properties | Unit | Requirement | Test Method |
|---------|---|-------------------|---------------------------------------|--------------------------|
| a | Tensile Strength @ + 25 °C | N/mm ² | 17 min. | ASTM D 638 |
| b | Melt Flow Rate (190 °C / 2.16 kg) | g/10 minutes | 0.25 min. | ASTM D 1238 or DIN 53735 |
| c | Specific Gravity @ + 25 °C | -- | 0.926 min.(MDPE) 0.941 min. (HDPE) | ASTM D 792 |
| d | Hardness @ + 25 °C | Shore D | 50 min | ASTM D 2240 |
| e | Water Absorption, 24 hours, @+ 25 °C | % | 0.05 max | ASTM D 570 |
| f. | Volume Resistivity @ + 25°C | Ohm-cm | 10 ¹⁵ min. | ASTM D 257 |
| g | Dielectric withstand, 1000 Volt/sec rise @ + 25 ° C | Volts/mm | 30,000 min. | ASTM D 149 |
| h | Vicat Softening Point | °C | 110 min. | ASTM D 1525 |
| i | Elongation | % | 600 min | ASTM D 638 |



**STANDARD SPECIFICATION FOR 3 LAYER
POLYTHYLENE COATING OF LINEPIPES**

Document No.

HOGPL-PL-00003

Rev

0

Page 6 of 26

| | | | | |
|----|--|---------|------------|-------------|
| j | Oxidative Induction Time in Oxygen at 220°C, Aluminum pan, no screen | Minutes | 10 | ASTM D3895 |
| k. | Environmental Stress Crack Resistance (ESCR) (for F50) ■ Medium Density [Condition "C"] ■ High Density [Condition "B"] | Hours | 300 300 | ASTM D1693 |
| l | Carbon Black Content | % | 2 min. | ASTM D 1603 |

3.2.5 COATING SYSTEM PROPERTIES

| Sr. No. | Properties | Unit | Requirement | Test Method |
|---------|---|------------------------------------|---|-----------------------|
| a | Bond Strength (using Type 2 Test Assembly i.e. Dynamometer) • @ 20+/-5 ° C • @ 65+/-5°C | Kg/cm | 8.0 min 5.0 min | DIN 30670 |
| b | Impact Strength (Min. of 30 impacts on body along the length. No breakdown allowed when tested at 25 KV) | Joules per mm of coating thickness | 7 min | DIN 30670 |
| c | Indentation Hardness • @ 23 +/- 2°C • @ 70 +/- 2°C | mm | 0.2 max 0.3 max | DIN 30670 |
| d | Elongation at Failure | % | 300 min. | DIN 30670 |
| e | Coating Resistivity (*) | Ohm - m ² | 10 ⁸ min. | DIN 30670 |
| f. | Heat Ageing (*) | - | Melt Flow Rate shall not deviate by more than 35% of original value | DIN 30670 |
| g | Light Ageing (*) | - | Melt Flow Rate shall not deviate by more than 35% of original value | DIN 30670 |
| h | Cathodic Disbondment • @ +65 °C after 30 days • @ +65 °C after 48 hrs | mm radius of disbondment (**) | 15 max. 7 max. | ASTM G42 |
| i | Degree of Cure of Epoxy • Percentage Cure, ΔH • ΔTg | % °C | 95 +3/-2 | CSA Z 245.20-98 (***) |



STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES

Document No.

HOGPL-PL-00003

Rev

0



NOTES

- (*) Test carried out in an independent laboratory of national/international recognition on PE topcoat is also acceptable.
- (**) Disbondment shall be equivalent circle radius of total unsealed area as per ASTM G42.
- (***) Temperature to which the test specimens are to be heated during cyclic heating shall however be as per the recommendations of epoxy powder manufacturer

3.2.6 The acceptable combinations of coating material shall be as per Annexure-I

3.3. REPAIR MATERIAL

Repair material shall be such that is capable of complying with the functional requirements stated for 3LPE coating under Para 3.1 above and shall be compatible with the 3LPE coating.

3.4. MATERIAL APPROVAL

The coating materials shall be pre-qualified and approved by the Company. Contractor shall submit data sheets of proposed material combinations to Company for prior approval. The data sheets shall cover all aspects required by this specification. The materials brands offered by Contractor for coating (i.e. Epoxy powder, co-polymer adhesive and the polyethylene compound) shall have proven compatibility. The contractor shall submit compatibility certificates from manufacturers in this regard. Only Company approved materials/combination of materials shall be used for coating of pipes

3.5. MATERIAL CERTIFICATES

For each batch of all materials, the Contractor shall obtain from the manufacturer(s) relevant certificates of material conformity and test results as per DIN 10204, 3.1 b. These certificates shall be submitted to Company for approval prior to the use of material for coating application.

3.6. In addition to Manufacturer's certificate, the Contractor shall draw samples from each batch of epoxy, adhesive and polyethylene in the presence of Company Representative and test for the following properties at the coating yard at least one week prior to its use, to establish compliance with the Manufacturer's test certificates.

3.7. MATERIAL IDENTIFICATION

All materials to be used shall be packed in damage free containers suitably marked with the following minimum information for identification:

- Name of the manufacturer.
- Type of material and product designation.
- Batch Number.
- Date and place of Manufacture
- Shelf Life / Expiry Date
- Storage Conditions
- Quantity

Any materials found without above identification markings shall be deemed suspect and rejected by Company. Rejected materials shall be promptly removed and replaced by the Contractor. Coating materials shall be segregated by batch number during shipment, storage and handling.

3.8. INFORMATION FOR FBE MATERIAL

Contractor shall obtain Infrared scan of each batch of epoxy powder to assure that powder used in manufacturing is same as powder used in qualification.

3.9. MATERIALS STORAGE

Coating materials shall be stored, handled and transported in accordance with the Manufacturer's recommendations. Storage time of materials shall not exceed the shelf life recommended by the

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 8 of 26 | |

Coating Manufacturer. The contractor shall be required to use all material on a date received rotation basis i.e. first in first used basis.

3.10. MATERIAL SUBSTITUTION

Contractor shall not substitute Company approved materials with alternative materials, even if alternative materials comply with the requirements of this specification, without written approval from Company.

3.11. ABRASIVE MATERIALS

Abrasives used for blast cleaning shall be clean, free of oil or contaminants and dry. The particle size shall be capable of producing the specified surface profile and roughness. Abrasive materials shall meet the requirements of ISO 11124-1.

4.0 COATING APPLICATION

4.1. COATING APPLICATION PROCEDURE SPECIFICATION

Prior to the commencement of any coating application activities, the Contractor shall submit a project specific Coating Application Procedure Specification, giving full details of the proposed coating process for Company's approval. The Coating Application Procedure Specification shall include, but not be limited to, the following information and proposals:

- a. Inspection of bare pipes and removal of surface defects and surface contaminants.
- b. Steel surface preparation, including preheating, removal of steel defects, method of pipe cleaning, dust removal, abrasive blast cleaning and surface profile; methods of measurements and consumables.
- c. Pipe heating, temperatures and control prior to epoxy application.
- d. Complete details of raw materials including current data sheets showing values for all the properties specified together with quality control and application procedure recommendations from manufacturer(s).
- e. Application of FBE powder, adhesive and polyethylene, including characteristics, temperature, line speed, application window, curing time, etc.
- f. Quenching and cooling, including time and temperature.
- g. Quality Assurance System, Quality Plan, Inspection and Test Plan and reporting formats, including instrument and equipment types, makes and uses, etc
- h. Detailed method of repair of coating defects duly classified depending upon nature and magnitude of defects and repair thereof including coating stripping technique.
- i. Details of instrument and equipment calibration methods and frequency of calibration including relevant standards and examples of calibration certificates.
- j. Complete details and inventory of laboratory and equipment for procedure qualification and regular production.
- k. Pipe handling and stock piling procedures.
- l. Sample of recording and reporting formats, including laboratory reports, certificates and requirement.
- m. Complete details of test certificates for raw materials including test methods and standards used.
- n. Test certificates from PE compound manufacturer for tests for thermal aging, coating resistivity and aging under exposure to light. These test certificates shall not be older than three years.
- o. Storage details of coating materials and chemicals.
- p. Continuous temperature monitoring at various stages of coating
- q. Health, Safety and Environmental (HSE) plans for the storage of raw materials and coating

| | | | |
|---|--|-----------------------|------------|
|  | <p align="center">STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES</p> | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 9 of 26 | |

application.

- r. Procedure for transferring of bare pipe identification numbers and applying coated pipe identification marking.

Coating application shall proceed only after written approval from Company has been obtained on the Coating Application Procedure Specification.

Contractor shall submit the detailed Inspection and Testing Plan (ITP) mentioned for the entire coating application to Company for review and approval. The Company will advise the Contractor of the specific inspection review, witness and HOLD points required by the Company or its Representatives by marking up the ITP.

After approval of the Coating Application Procedure Specification and ITP by the Company no changes shall be in the procedure specification or ITP shall be permitted. Unavoidable changes, if any, shall be brought to the notice of Company and specific written approval obtained before implementing the same.

4.2. COATING APPLICATION PROCEDURE QUALIFICATION

4.2.1. GENERAL

Prior to start of production, the Contractor shall, at his expense, carry out a coating PQT for each pipe diameter on max. wall thickness, for each type of pipe, for each coating material combination, and for each plant, to prove that his plant, materials, and coating procedures result in a quality of end product conforming to the properties stated in clause 3.2, relevant standards, specifications and material manufacturer's recommendations. Contractor shall give seven (7) working days" notice to witness all procedures and tests.

A batch representing a normal production run, typically 15 pipes, shall be coated in accordance with the approved coating procedure and the coating operations witnessed by Company Representative. Out of these pipes, at least one pipe shall be coated partly with epoxy and partly with both epoxy and adhesive layers.

At least 5 (five) test pipes shall be selected by Company Representative for coating procedure approval tests and shall be subjected to procedure qualification testing as described hereinafter. Company Representative shall witness all tests. Out of 5 (five) test pipes, 1 (one) pipe partly coated with epoxy and partly coated with both epoxy and adhesive layers shall be included. Remaining 4 (four) test pipes shall have all three layers.

During PQT, the Contractor shall qualify various procedures forming a part of coating operations as detailed subsequently.

4.2.2. PIPE PRE-HEATING

Temperature variation due to in-coming pipe temperature, line speed variation, pipe wall thickness variation, emissivity, interruptions, etc. shall be established and documented during PQT stage .Proper functioning of pipe temperature monitoring and recording system including audible alarm shall be demonstrated.

4.2.3. SURFACE PREPARATION

The procedure to clean and prepare the pipe surface shall be in accordance with the requirements of this specification. The ratio of shot to grit shall be established during procedure qualification testing, such that the resultant surface profile is not dished and rounded. The qualification shall be performed through a visual inspection, measurement of roughness and check of the presence of dust on the abrasive blast cleaned pipe surface.

4.2.4. PIPE HEATING AND EPOXY POWDER APPLICATION

Parameters affecting pipe heating such as rating and frequency of induction heater or number of burners in case of gas heating vis-à-vis pipe thickness and line speed and epoxy application such as air pressure in the spray guns, dew point of air, pipe surface temperature, etc. shall be established and documented so that specified minimum epoxy thickness and other coating quality requirements are met with.

In addition quality and quantity of epoxy that can be recycled shall be established. For this purpose,

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 10 of 26 | |

samples of reclaimed epoxy powder shall be drawn and subjected to visual examination, thermal analysis and moisture content testing. Only if the properties of reclaimed epoxy are established to be within manufacturer specified range, reclaimed epoxy shall be allowed to be recycled. Contractor shall also establish maximum quantity of reclaimed epoxy that can be mixed with fresh epoxy without affecting quality of coating.

4.2.5. ADHESIVE AND PE APPLICATION

Parameters affecting application of co-polymer adhesive and polyethylene layers such as line speed, fusion bonded epoxy curing time and temperature of co-polymer adhesive and polyethylene, quenching time and temperature, etc. shall be established and documented so that specified minimum coating thickness and other quality requirements specified are met with.

4.2.6. TESTING

At least five (5) test pipes, including one (1) pipe partly coated with epoxy and one (1) pipe partly coated with both epoxy and adhesive layers, shall be randomly selected by Company Representative for carrying out PQT as per Table 5.3.1. The procedure shall be considered qualified only when all tests as per Table 5.3.1 meet specified requirements. In case any of the tests fails to comply specified requirement, coating application procedure shall be re-qualified after necessary modifications. Company representative shall witness all tests.

All pipes coated during coating application procedure qualification shall be subjected to same visual and other inspection as required during production coating. Acceptance criteria shall be as specified under Section 5.4 of this specification.

Company reserves the right to conduct any or all the tests required for Coating Application Procedure Qualification through an independent laboratory or agency, at the cost of the Contractor, when in Company's opinion, the test results are deemed suspect. Company decision in this regard shall be final.

4.2.7. PQT REPORT

Upon completion of the testing, the Contractor shall prepare and submit to the Company a detailed report covering operating and controlling parameters, inspection and test reports and material test certificates for Company approval. Only upon written approval from Company, the Contractor shall commence production coating.

4.2.8. DISPOSAL OF TEST PIPES

On completion of coating application procedure qualification, the Contractor shall completely remove the coating on all remaining intact pipes coated for the purpose of procedure qualification and recycle them for production coating.

4.2.9. PROCEDURE RE-QUALIFICATION

The coating application procedure shall be re-qualified in the event of, but not limited to, the following:

- Every time there is a change in the previously qualified procedure
- Every time there is a change in the epoxy/adhesive/polyethylene manufacturer and change in formulation of any of the material.
- Every time the coating yard is shifted from one location to another location/ critical equipment viz. induction heater, epoxy spray system, extruder etc. are changed.
- Any time when, in Company's opinion, the properties are deemed to be suspect during regular production tests.

4.3. PIPE SURFACE PREPARATION

4.3.1. PRE-INSPECTION

Prior to cleaning operation, Contractor shall visually examine the pipes and shall ensure that all defects,

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 11 of 26 | |

flats and other damages have been repaired or removed. The Contractor shall also remove marking stickers, if any, present within the pipe. Record shall be kept of such marking on the stickers to ensure traceability of pipe after coating

4.3.2. REMOVAL OF SURFACE CONTAMINANTS

Any oil, grease, salt or other contaminants detrimental to the formation of a good coating bond or coating quality shall be removed prior to coating application. Contaminants may be removed by the use of non-oily solvents. Gasoline or kerosene shall not be used for this purpose. Visible oil and grease spots shall be removed by solvent wiping. Solvent cleaning shall be in accordance with SSPC-SP1. Steel surface shall be allowed to dry before abrasive cleaning.

4.3.3. PRE-HEATING

The pipe shall be preheated prior to blast cleaning to a temperature at least 5°C above the dew point to remove moisture and to raise slivers and other similar surface defects.

4.3.4. BLAST CLEANING

Prior to blasting operation, pipe ends shall be closed to prevent any abrasives and/or foreign material from entering the pipe’s interior during blasting. Alternatively the Contractor may link the pipes suitably together to prevent the entry of any short/grit into the pipe. Pipe shall be handled in a manner so as to prevent any damage to bevels.

The external surface of the pipe shall be cleaned by dry abrasive blast cleaning unit(s). The abrasive blast cleaning unit(s) shall have an effective dust collection system to ensure total removal of dust generated during blast cleaning from the pipe surface. Traps, separators and filters shall be checked for condensed water and oil at the start of each shift and emptied and cleaned regularly. Metallic abrasives shall be continuously sieved to remove “fines” and “contaminants” and the quality checked at every four hours.

At no time shall the blast cleaning be performed when the relative humidity exceeds 85% or when the steel temperature is less than 5°C higher than the dew point, unless the pipes are preheated to a temperature of 65°C to 85°C.

The ratio of shots and grits in abrasives used for blast cleaning shall be such that the resulting surface profile does not appear dished and rounded when viewed under 30X magnification and specified anchor pattern is achieved.

Any abrasive and/or foreign material in the pipe shall be removed before further coating operations. Immediately after the blast cleaning operation, all dust and grit shall be removed from inside of the pipe by a combination of air blast, brushing and vacuum cleaning.

4.3.5. REPAIR OF SURFACE IMPERFECTIONS

All surface defects visible on blast cleaned pipes such as slivers, scab, burns, laminations, weld spatters, gouges, scores, indentations, slugs or any other defect considered injurious to the coating integrity shall be removed by filing or grinding in consultation with Company Representative.

The method employed to remove surface defects shall not burnish or destroy the anchor pattern or contaminate the surface with oil or water. Pipe repairs by grinding resulting in ground areas more than 50 mm in diameter shall be re-blasted.

After any grinding or mechanical repairs, the remaining wall thickness shall be checked and any pipe having wall thickness less than 95% of specified wall thickness shall be kept aside and disposed off as per the instructions of Company Representative.

4.3.6. ACCEPTANCE OF SURFACE PREPARATION

Upon Completion of the blasting operations, the Contractor’s quality control supervisor shall inspect the pipes for their compliance to requirements specified below:

- The surface finish after blast cleaning shall conform to near white metal finish i.e. Sa 2 ½ of Swedish Standard SIS 055900.
- Anchor pattern/roughness profile shall be between 50 to 70 microns.

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 12 of 26 | |

- Dust contamination shall be rating max. 2 as per ISO 8502-3.
- Salt content shall be less than 2 µg/cm².

Pipes complying above requirements shall be accepted. Pipes that don't comply with above requirements shall be returned for re-blasting.

In order to ensure that pipes with improper surface preparation or unacceptable defects are not processed further, provisions shall be available to lift the pipes from inspection stand.

4.3.7. ELAPSED TIME FOR COATING APPLICATION

Maximum allowable elapsed time between completion of the blasting operations and commencement of pipe heating for coating application shall be as given below:

| Relative Humidity % | Maximum Allowable Elapsed Time |
|---------------------|--------------------------------|
| >80 | 2 hours |
| 70 to 80 | 3 hours |
| <70 | 4 hours |

Pipes that have exceeded the allowable elapsed time shall be returned for complete re-blasting. Any pipe showing flash rusting shall be re-blasted even if the above conditions have not been exceeded.

Pipe handling between abrasive blasting and pipe coating shall not damage the surface profile achieved during blasting. Any pipe having damage to the surface exceeding 200mm² shall be sent for re-blasting.

4.4. COATING APPLICATION

The external surface of the cleaned pipe conforming to clause 4.3 of this specification shall be immediately coated with 3-layer extruded polyethylene coating in accordance with the procedures approved by Company, relevant standards and this specification. In general the procedure shall be as follows:

4.4.1. PIPE HEATING

- Immediately prior to heating of pipe, all dust and grit shall be removed from inside of the pipe by combination of air blast, brushing and vacuum cleaning. Suitable arrangement shall be made to protect the bevel ends from getting damaged during the coating operation
- Induction heater or gas fired heating shall be used for heating the pipe. The method shall be capable of maintaining uniform temperature along the total length of the pipe, and shall be such that it shall not contaminate the surface to be coated. In case of induction heating, appropriate frequency shall be used to ensure 'deep heating' and intense skin heating is avoided. Gas fired heating system shall be well adjusted so that no combustion products are deposited on the steel surface. This shall be demonstrated on bare pipes prior to start of PQT. Oxidation of the cleaned pipe surfaces prior to coating (in the form of blueing or other apparent oxide formation) is not acceptable.
- External surface of the pipe shall be heated to about 190 °C or within a temperature range (min. to max.) as recommended by the powder manufacturer. Required pipe temperature shall be maintained as it enters the coating chamber.
- Temperature of the pipe surface shall be continuously monitored & recorded by using suitable instruments such as infrared sensors, contact thermometers, thermocouples etc. The recording method shall allow correlating each line pipe. The monitoring instrument shall be able to raise an alarm/activate audio system (hooter) in the event of tripping of induction heater/ gas fired heater or in the event of pipe temperature being outside the range recommended by the manufacturer. Any deviation from the application temperature range recommended by manufacturer shall be rectified. If immediate rectification is not feasible, the production shall be stopped until cause of deviation has

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 13 of 26 | |

been removed. Any pipe coated during the duration of temperature deviation shall be identified by marking and rejected. Such rejected pipes shall be stripped, re-cleaned and recoated.

- e. Temperature measuring & monitoring equipment shall be calibrated twice every shift and/or as per Company Representative's instruction.
- f. Contractor shall ensure that pipe surface emissivity variations are minimized during pipe heating. To avoid significant variance, more than once blasted joints should be coated at the same time and not mixed with joints blasted only once

4.4.2. APPLICATION OF EPOXY, ADHESIVE AND POLYETHYLENE

The heated pipe surface shall be applied with following coating layers:

| Specified Pipe OD, Inches (mm) | Minimum Coating Thickness In mm | | | | |
|--------------------------------------|---------------------------------|-------------------------|----------------------|-------------------------|---------------------|
| | FBE ^[1] | Adhesive ^[2] | PE ^[2, 3] | Total ^[3, 4] | |
| | | | | Normal Type (n) | Reinforced Type (v) |
| Up to 4½ (114.3) | 0.15 | 0.2 | 1.45 | 2.0 | 2.5 |
| Over 4½ (114.3) Up to 10¾ (273.1) | 0.15 | 0.2 | 1.65 | 2.0 | 2.7 |
| Over 10¾ (273.1) to below 20 (508.0) | 0.15 | 0.2 | 1.85 | 2.2 | 2.9 |
| From 20 (508.0) to below 32 (813.0) | 0.15 | 0.2 | 2.15 | 2.5 | 3.2 |
| From 32 (813.0) and above | 0.15 | 0.2 | 2.65 | 3.0 | 3.7 |

Notes:

1. Epoxy shall be applied by electrostatic spray method the maximum thickness shall not exceed the epoxy thickness specified by epoxy powder manufacturer.
2. Grafted co-polymer adhesive and polyethylene layers shall be applied by extrusion.
3. In case HDPE is used as top coat, 10% reduction in PE top coat thickness is permissible
4. Unless indicated otherwise in Purchase Order, total thickness corresponding to Normal Type (n) coating shall be applicable.

EPOXY APPLICATION

Epoxy powder shall be sprayed on to heated pipe using electrostatic spray technique. Only dry air, free of oil and moisture shall be used in the coating chamber and epoxy spraying system. Dew point of air supplied to epoxy spray/recycling system shall be at least - 40°C. Air pressure in the epoxy spray guns shall be controlled, continuously monitored and recorded at least four times per working shift (maximum 12 hours). The air pressure shall be controlled within the limits established during coating application procedure qualification. The monitoring system shall be able capable of raising an alarm / activate audio system (hooter) in the event of change in air pressure beyond the set limits. All pipes coated during the duration of air pressure deviation beyond set limits shall be stripped and recoated.

The recycled epoxy powder mixing with fresh epoxy powder shall be permitted subject to following conditions:



- Quality of recycled epoxy powder has been established to be acceptable during coating application procedure qualification.
- Proportion of the recycled epoxy powder in the working mix does not exceed that established during coating application procedure qualification or 20% at a time, whichever is less.
- Quality of the recycled powder is checked minimum once per working shift (maximum 12 hours) by visual examination, thermal analysis & moisture content testing and properties of recycled epoxy are established to be within manufacturer specified range.

ADHESIVE AND POLYETHYLENE LAYER APPLICATION

Extruded adhesive layer shall be applied before gel time of the epoxy coating has elapsed and within the window recommended by the manufacturer. The Contractor shall establish, to the satisfaction of the Company Representative, that the adhesive is applied within the gel time window of epoxy and at the temperature recommended by the adhesive manufacturer. The Contractor shall state the minimum and maximum time interval between epoxy and adhesive application at the proposed pre-heat temperature and line speed.

Extruded polyethylene layer shall be applied over the adhesive layer within the time limit established during PQT stage and within the time/temperature range recommended by the manufacturer. The extrusion temperatures of the adhesive and polyethylene shall be continuously recorded. The monitoring instruments shall be independent of the temperature control equipment. The instruments shall be calibrated prior to start of each shift.

The extrusion temperatures of the adhesive and polyethylene shall be continuously monitored and recorded at least four times per working shift (maximum 12 hours). The monitoring instruments shall be independent of the temperature control equipment. The instruments shall be calibrated prior to start of each shift.

Contractor shall ensure that there is no entrapment of air or void formation along the seam weld (where applicable) during application of coating.

Resultant coating shall have a uniform gloss and appearance and shall be free from air bubbles, wrinkles, irregularities, discontinuities, separation between layers of polyethylene & adhesive, etc.

The coated pipe shall be subsequently quenched and cooled in water for a period that shall sufficiently lower the temperature of pipe coating to allow handling and inspection.

4.4.3. COATING CUT BACK

Coating and/or adhesive shall terminate 120 mm +20 / -0 mm from pipe ends. Contractor shall adopt mechanical brushing for termination of the coating at pipe ends. Edge of the coating shall be shaped to form a bevel angle of 30° to 45°.

4.4.4. REJECTION OF COATING

Failure of the Contractor to comply with above coating application requirements including approved coating application procedure shall result in rejection of the coating applied and the Contractor shall remove the coating from such coated pipes and recycle the pipes through entire coating process

5.0 INSPECTION AND TESTING

5.1. GENERAL

The Contractor shall establish and maintain such quality assurance system as are necessary to ensure that goods or services supplied comply in all respects with the requirements of this specification. The minimum inspection and testing to be performed shall be as indicated subsequently herein. Pipes with unacceptable coating shall be stripped and recycled.

5.2. TESTING OF MATERIALS

One week prior to use, Contractor shall carry out following tests on samples randomly drawn by Company Representative from each batch of raw materials proposed to be used for coating application in the next week's production to establish compliance with coating material manufacturer's

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 15 of 26 | |

test certificates.

| Table 5.2 : Coating Material Testing | | |
|---|--|--|
| Material | Test | Test method and acceptance criteria |
| Epoxy Powder | Gel Time, Cure Time, Moisture Analysis and Thermal Characteristics (Tg1, Tg2, ΔH) | As per CSA standard Z245.20.02 |
| Adhesive | Specific Gravity, Melt Flow Rate(Condition 190/2.16), Vicat Softening Point | As per Section 3.2.3 (b) of this specification |
| Polyethylene | Melt Flow Rate(Condition 190/2.16) Specific Gravity, Vicat Softening Point, Moisture Content, Oxidative Induction time | As per Section 3.2.4 (a) of this specification |

In case of failure of any of the above tests, batch of material from which samples are drawn shall be tested for all properties specified under section 3.2.1, 3.2.2 and 3.2.3 (except ESCR) of this specification. If all tests results comply with required properties, the batch shall be accepted for coating. If any of the tests fail to comply with required properties, batch of material that fails to comply shall be rejected

5.3. TESTING OF COATING

Testing requirements and frequency of testing during PQT and production coating shall be as per Table 5.3.1 and Table 5.3.2 respectively. The method of testing, acceptance criteria and re-testing shall be as described hereinafter.

| Table 5.3.1 : Testing Requirement for Coating Procedure Qualification | | | | |
|--|---|--------------------------|--|----------------|
| Sl. No | Test | Testing Frequency | Test Method And Acceptance Criteria | Remarks |
| a | Degree of Cure | Two Test Pipe | Section 5.3.1 | Note 1 |
| b | Adhesion Tests | One Test Pipe | Section 5.3.2 | Note 2 |
| c | 2.5° Flexibility Test | One Test Pipe | Section 5.3.3 | Note 2 |
| d | Cross Section and Interface Porosity Test | One Test Pipe | Section 5.3.4 | Note 2 |
| e | Bond Strength | Three Test Pipes | Section 5.3.5 | Note 3 |





| | | | |
|--|--|--|--|
| | | | |
|--|--|--|--|


| | | | | |
|---|----------------------------------|------------------|----------------|-----------|
| f | Impact Strength | Three Test Pipes | Section 5.3.6 | |
| g | Indentation Hardness | All Test Pipes | Section 5.3.7 | Note 4 |
| h | Percentage Elongation at Failure | All Test Pipes | Section 5.3.8 | Note 4 |
| i | Air Entrapment Test | All Test Pipes | Section 5.3.10 | Note 4 |
| j | Thickness Measurements | | | |
| | Epoxy Layer | One Test Pipe | Section 5.3.11 | Note 2 |
| | Adhesive Layer | One Test Pipe | | Note 2 |
| | Total Coating Thickness | All Coated Pipes | | Note 5 |
| k | Holiday Inspection | All coated Pipes | Section 5.3.12 | Note 5 |
| l | Cathodic Disbondment Test | | | |
| | 30 days test at (+) 65° C | One Test Pipe | Section 5.3.9 | Note 3, 6 |
| | 48 hour test at (+) 65° C | One Test Pipe | | |

Notes:

1. Test shall be carried out on one partly coated test pipe one test pipe coated with all three layers.
2. Test shall be carried out on test pipe partly coated pipe
3. Test shall be carried out on test pipes coated with all three layers.
4. Test shall be carried out on all test pipes coated with all three layers
5. Test shall be carried out on all pipes coated with all three layers.
6. Both 30 days and 48 hour tests shall be carried out for a particular material combination and pipe diameter. In case results for 30 days test are satisfactory, subsequent coating application procedure qualification for different pipe size with same coating material combination, 48 hours test shall be acceptable

| Table 5.3.2 : Testing Requirement During Production Coating | | | | |
|--|----------------|---------------------|-------------------------------------|-----------|
| Sl. No | Test | Testing Frequency | Test Method and Acceptance Criteria | Remarks |
| a | Degree of Cure | One Pipe/Shift | Section 5.3.1 | Note 1, 2 |
| b | Adhesion Tests | One Pipe/ Shift | Section 5.3.2 | Note 1, 2 |
| c | Bond Strength | One out of 25 Pipes | Section 5.3.5 | Note 1, 2 |





| | | | | |
|-------------------------|---|---|----------------|-----------|
| d | Impact Strength | One Pipe/Shift | Section 5.3.6 | Note 1, 2 |
| e | Indentation Hardness | One Pipe/Shift | Section 5.3.7 | Note 1, 2 |
| f | Air Entrapment Test | One out of 25 Pipes | Section 5.3.10 | Note 1, 2 |
| g | Thickness Measurements | | | |
| | Epoxy Layer | Once in the beginning of Shift or whenever plant restart after stoppage | Section 5.3.11 | Note 1, 4 |
| | Adhesive Layer | | | |
| Total Coating Thickness | All Pipes | | | |
| h | Holiday Inspection | All Pipes | Section 5.3.12 | Note 1, 4 |
| i | Cathodic Disbondment Test 48 hour test at (+) 65° C | Once per week or each batch of epoxy used whichever is early | Section 5.3.9 | Note 1, 3 |

Notes:

- 1 Working shift shall be maximum 12 hours.
- 2 In case the test fails to comply the specified requirement, preceding and succeeding coated pipes shall be tested. If both pipes pass the test, then the remainder of the coated pipes in the lot shall be accepted. If tests on any one of the two pipes fail to meet the specified requirements then either all pipes shall be individually tested or entire lot rejected at the option of the Contractor. All rejected coated pipes shall be stripped and re-coated.
- 3 In case of failure of test, the test shall be repeated using two additional samples taken from same end of pipe. In case both test pass, the pipes shall be accepted. If one or both tests fail all pipes coated after the previous acceptable test and prior to next acceptable test shall be reject. All rejected coated pipes shall be stripped and re-coated.
- 4 Pipes not meeting the specified requirements shall be rejected. All rejected coated pipes shall be stripped and re-coated

5.3.1. DEGREE OF CURE

The samples for epoxy testing shall be taken from cut back area, separated from adhesive and polyethylene layer by silicon coated sulphite paper, in case of fully coated pipe and from epoxy coated section of pipe partly coated pipe during application procedure qualification.

Epoxy samples (minimum 4 no.) shall be removed from the coated pipe using hammer and cold chisel and the samples shall be taken for cure test using DSC procedure. Care shall be taken to remove the samples of full film thickness avoiding inclusion of steel debris. Glass transition temperature differential (ΔT_g) and % cure (ΔH) shall comply with the requirements of Section 3.2.5 (i).

5.3.2. ADHESION TESTS

For Pre Qualification Testing (PQT)

Adhesive test (24 hrs or 48 hrs) shall be carried out on epoxy coated pipe. Test method, no. of test specimen and acceptance criteria shall comply CSA Z.245.20-02, Table 4.

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 18 of 26 | |

For PQT and Regular Production Testing

Adhesion of epoxy layer shall be determined at ambient temperature by the “St Andrews Cross” method i.e. by cutting two straight lines through the epoxy layer with a sharp knife at the cut -back portion of the pipe from which the Degree of Cure test has been carried out. The incisions shall intersect at an angle of 30°/150°. The epoxy coating shall resist disbondment from the steel when attempts are made to flick/lift the coating from the 30° angle with a sharp knife.

5.3.3. 2.5° FLEXIBILITY TEST

Samples for 2.5° Flexibility test shall be taken as indicated under Section 5.3.1. 2.5° Flexibility test shall be carried out at a test temperature of 0°C. Test method, number of test specimen and acceptance criteria shall comply CSA Z.245.20-02, Table 4.

5.3.4. CROSS-SECTION & INTERFACE POROSITY TEST

Samples for cross section porosity and interface porosity test shall be taken as indicated under Section 5.3.1. Cross section porosity and interface porosity test method, number of test specimen and acceptance criteria shall comply CSA Z.245.20-02, Table 4.

5.3.5. BOND STRENGTH TEST

One test shall be performed at cut back portion at each end and one in the middle of test pipe for each specified temperature (i.e. total 6 tests per pipe).

Test method and acceptance criteria shall be as per Section 3.2.5, Sl. No. (a) Of this specification. The coating system shall disbond/ separate cohesively either in adhesive layer or in polyethylene layer. Majority of the peeled off area on the pipe shall show presence of adhesive. Disbondment/separation at epoxy to steel interface or epoxy / adhesive interface or adhesive / polyethylene interface shall not be permitted. The failure mode shall also be recorded for each test.

5.3.6. IMPACT STRENGTH TEST

Test method and acceptance criteria shall be as per Section 3.2.5, Sl. No. (b) of this specification.

A minimum of 30 impacts, located equidistant along the length of test pipe, shall be performed. Immediately after testing, the test area shall be subjected to holiday detection. The pipe shall be rejected if any holiday is noted in the test area.

5.3.7. INDENTATION HARDNESS

Test method and acceptance criteria shall be as per Section 3.2.5, Sl. No. (c) of this specification.

One test shall be performed at cut back portion at each of test pipe for each specified temperature (i.e. total 4 tests per pipe).

5.3.8. PERCENTAGE ELONGATION AT FAILURE

Six samples from each test pipe shall be tested in accordance with Section 3.2.5, Sl. No. (d) of this Specification. Only one sample per pipe may fail.

5.3.9. CATHODIC DISBONDMENT TEST

Test shall be carried out on pipe having all three layers as per Section 3.2.5, Sl. No. (h) of this Specification.

5.3.10. AIR ENTRAPMENT TEST

Air entrapment test shall be carried out by examining strips of coating removed from coated pipe under 30X magnification hand held microscope for presence of voids.

Strips shall be obtained from the cut back area of pipe. Additional strips shall be taken from weld area when applicable. Alternatively strips from bond strength tests may be used.

Bond strength strip shall be viewed from the side and at the failure interface. Utility knife shall be used to cut the edge of the coating to a 45° angle at pipe and cut surface viewed under microscope. Similar

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 19 of 26 | |

examination shall be done in the coating strip obtained from cut back area. The polyethylene and adhesive layers shall have no more than 10% of the observed area taken up with air entrapment (porosity or bubbles). Air entrapment shall not occupy more than 10% of the thickness in each case. Bubbles shall not link together to provide a moisture path to the epoxy layer.

5.3.11. THICKNESS MEASUREMENTS

EPOXY AND ADHESIVE LAYER

Epoxy and adhesive layer thickness shall be checked at one meter spacing at 3, 6, 9 and 12 o'clock positions. All readings must meet the minimum thickness specified under section 4.4.3. Epoxy and adhesive layer thickness shall be measured on pipe partly coated with epoxy and partly coated with epoxy and adhesive.

TOTAL COATING THICKNESS

The coating thickness shall be determined by taking at least 10 measurements at locations uniformly distributed over the length and periphery of each pipe. In case of welded pipes, five of the above readings shall be made at the apex of the weld seam, uniformly distributed over the length of the coated pipe

5.3.12. HOLIDAY DETECTION

Each coated pipe length shall be checked over 100% of coated surface by means of a "holiday detector" of a type approved by Company for detecting holidays in the finished coating.

The holiday detector shall be a low pulse D.C. full circle electronic detector with audible alarm and precise voltage control complying with DIN VDE 0433 Part 2.

Holiday detector shall be calibrated at least once every 4 hours of production. Contractor shall have necessary instruments or devices for calibrating the holiday detector.

Travel speed during holiday inspection shall be as recommended by the manufacturer of holiday detector.

The holiday detector set voltage and acceptance criteria shall be as follows:

ONLY EPOXY / EPOXY AND ADHESIVE COATED PIPES

Only epoxy coated section shall be subject to holiday inspection at a test voltage set to exceed 5V / micron of epoxy thickness. Section of pipe coated with both epoxy and adhesive shall be tested at a voltage of 25kV. No holidays are permitted.

PIPE COATED WITH ALL THREE LAYERS

The coated pipe shall be inspected with the holiday detector set at minimum 25kV.

Coated pipe shall be rejected if more than one (1) holiday & area more than 100 cm² in size are detected in its length attributable to coating process.

Coated pipe with a single holiday of an area equal or less than 100cm² shall be accepted after repair.

In case more than 10% of coated pipes per shift production are rejected on account of holidays, the Contractor shall stop production and make a detailed investigation and submit a report to the Company representative on the probable cause(s) for the holidays. Production shall restart only after such a cause has been rectified.

5.4 REPAIR OF COATING DAMAGES DUE TO TESTING

Damages occurring to pipe coating during the above tests shall be repaired in accordance with the Section 7 of this specification

5.5 VISUAL INSPECTION

Pipes shall be visually inspected throughout the coating process from incoming bare pipe to finished coated pipes as described herein below:

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 20 of 26 | |

5.5.1. INSPECTION OF INCOMING PIPES

All incoming pipes, before any coating application process starts, shall be examined visually for any surface defects such as split seams, dents, gouges, slivers or other imperfections that would make the pipe unsuitable for use. Pipes with such defects shall be repaired in accordance with approved procedure before they are released for further processing.

5.5.2. INSPECTION OF BLAST CLEANED PIPES

Surface of pipes after blast cleaning shall be examined for any defects injurious to coating application. Surface profile shall be examined by using suitable instrument such as surface profile depth gauge for compliance to anchor pattern requirements. In addition the pipe surface shall be checked for the degree of cleanliness (Sa 2½), degree of dust and shape of profile.

In addition, inside surface of the pipe shall also be visually examined for presence of any foreign material or shots and grit (free or embedded/sticking to pipe inside surface). Any foreign material or shots/grit present in the pipe shall be completely removed by suitable means (mechanical brush, high pressure air jets, by tilting of pipe etc.).

The blast-cleaned surface shall not be contaminated with dirt, dust, metal particles, oil, water or any other foreign material, nor shall the surface or its anchor pattern be scarred or burnished.

5.5.3. INSPECTION OF COATED PIPES

Each coated pipe shall be visually checked for imperfections and irregularities of the coating.

The resultant coating shall have a uniform appearance with natural colour & gloss and shall be free from air bubbles, blisters, wrinkles, scratches, engravings, cuts, swellings, disbanded zones, tears, voids, irregularities, discontinuities and separation between layers of FBE/adhesive/PE. Special attention shall be paid to the areas adjacent to the weld seam (if applicable). Coating surface shall not be physically damaged or contaminated with any foreign material such as dirt, metal particles, coating debris during application, curing, and handling process.

5.6 SOLUBLE SALT MEASUREMENTS

Chlorides and ferrous salts present on pipe surface that can affect the coating performance shall be monitored prior to application of coating.

After blast cleaning, all pipes shall be tested for salt contamination. One test shall be carried out at each end of each pipe using salt meter (SCM 400 or approved equivalent). The acceptance criteria shall be 2 µg/cm². Any pipe having salt contamination exceeding 2 µg/cm² shall be treated by phosphoric acid wash followed by de-ionized water wash in accordance with the recommendations of the manufacturer. The Contractor shall submit a detailed procedure for phosphoric acid wash for Company approval.

6.0 HANDLING, TRANSPORTATION AND STORAGE

- 6.1. The Contractor shall be fully responsible for the pipe and for the pipe identification marking from the time of "taking over" of bare pipe from Company until such time that the coated line pipes are 'handed over' and/or installed in the permanent installation as the case may be according to the provisions of the CONTRACT.

At the time of "taking over" of bare pipes Contractor shall inspect and record all the relevant details referred above including pipe defects in the presence of Company. All pipes shall be checked for bevel damages, weld seam height, dents, gouges, corrosion and other damages. Company Representative shall decide whether pipe defects / damages are suitable for repair. Damage to the pipes that occur after the Contractor has taken delivery such as dents, flats, or damage to the weld ends shall be cut off or removed and pipes re-bevelled and repaired again as necessary. The cost of this work, as well as that of the pipe lost in cutting and repair shall be to the Contractor's account. All such works shall be carried out after written approval of the Company. Any reduction in length shall be indicated in the Contractor's pipe tracking system.

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 21 of 26 | |

- 6.2. The Contractor shall unload, load, stockpile and transport the bare pipes within the coating plant(s) using suitable means and in a manner to avoid damage to pipes.

The Contractor shall stockpile the bare pipes at the storage area of the coating plant. The Contractor shall prepare and furnish to Company a procedure/calculation generally in compliance with API RP-5L1 for stacking of pipes of individual sizes, which shall be approved by Company prior to commencement.

- 6.3. The Contractor shall load, unload, transport and stockpile the coated pipes within the coating plant using approved suitable means and in a manner to avoid damage to the pipe and coating. The Company shall approve such procedure prior to commencement of work.

- 6.4. Coated pipes maybe handled by means of slings and belts of proper width (minimum 60 mm) made of non- abrasive/non-metallic materials. In this case, pipes to be stacked shall be separated row by row to avoid damages by rubbing the coated surface in the process of taking off the slings. Use of round sectional slings is prohibited. Forklifts may be used provided that the arms of the forklift are covered with suitable pads, preferably rubber.

- 6.5. Bare/coated pipes at all times shall be stacked completely clear from the ground, at least 300 mm, so that the bottom rows of pipes remain free from any surface water. The pipes shall be stacked at a slope so that driving rain does not collect inside the pipe. Bare/coated pipes may be stacked by placing them on ridges of sand free from stones and covered with a plastic film or on wooden supports provided with suitable cover. This cover can be of dry, germ free straw covered with plastic film, otherwise foam rubber may be used. The supports shall be spaced in such a manner as to avoid permanent bending of the pipes.

Stacks shall consist of limited number of layers such that the pressure exercised by the pipe's own weight does not cause damages to the coating. Contractor shall submit calculations for Company approval in this regard. Each pipe section shall be separated by means of spacers suitably spaced for this purpose. Stacks shall be suitably secured against falling down and shall consist of pipe sections having the same diameter and wall thickness. The weld seam of pipes shall be positioned always in a manner so as not to touch the adjacent pipes.

The ends of the pipes during handling and stacking shall always be protected with bevel protectors.

- 6.6. The lorries used for transportation shall be equipped with adequate pipe supports having as many round hollow beds as there are pipes to be placed on the bottom of the lorry bed. Total width of the supports shall be at least 5% of the pipe length and min. 2 no. support shall be provided. These supports shall be lined with a rubber protection and shall be spaced in a manner as to support equal load from the pipes the rubber protection must be free from all nails and staples where pipes are in contact. The second layer and all following layers shall be separated from the other with adequate number of separating layers of protective material such as straw in plastic covers or mineral wool strips or equivalent, to avoid direct touch between the coated pipes.

All stanchions of Lorries used for transportation shall be covered by non-abrasive material like rubber belts or equivalent. Care shall be exercised to properly cover the top of the stanchions and other positions such as reinforcement of the truck body, rivets, etc. to prevent damage to the coated surface. Slings or non-metallic straps shall be used for securing loads during transportation. They shall be suitably padded at the contact points with the pipe

- 6.7. Materials other than pipes and which are susceptible of deteriorating or suffering from damages especially due to humidity, exposure to high thermal excursions or other adverse weather conditions, shall be suitably stored and protected. Deteriorated materials shall not be used and shall be replaced at Contractor's expenses. These materials shall always be handled during loading, unloading and storage in a manner so as to prevent any damage, alteration and dispersion. When supplied in containers and envelopes, they shall not be dropped or thrown, or removed by means of hooks, both during the handling operations till their complete use. During unloading, transport and utilization, any contact with water, earth, crushed stone and any other foreign material shall be carefully avoided.

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 22 of 26 | |

Contractor shall strictly follow Manufacturer's instructions regarding storage temperature and methods for volatile materials that are susceptible to change in properties and characteristics due to unsuitable storage. If necessary the Contractor shall provide for a proper conditioning.

- 6.8.** In case of any marine transportation of bare/coated line pipes involved, the same shall be carried out in compliance with API RP 5LW. Contractor shall furnish all details pertaining to marine transportation including drawings of cargo barges, storing/stacking, sea fastening of pipes on the barges/marine vessels to the company for approval prior to undertaking such transportation works. In addition contractor shall also carry out requisite analyses considering the proposed transportation scheme and establish the same is safe and stable. On-deck overseas shipment shall not be allowed.

7.0 REPAIR OF COATING AND FINAL ACCEPTANCE

7.1. COATING REPAIR

Contractor shall submit and qualify a comprehensive repair procedure for carrying out repairs of defects. The procedure shall be subject to approval of Company. The repair procedure shall cover application over bare as well as over coated pipe surfaces.

Testing of repairs shall be in the same form as testing production coating. All repairs shall result in a coating thickness no less than the parent coating thickness. Defects, repairs and acceptability criteria shall be as follows:

- Pipes showing porosities or very small damage not detected during holiday test and having a surface area less than 0.5cm² or linear damage (cut) of less than 3 cm, and does not expose bare steel, shall be repaired by stick using material of same quality as coating.
- Damage to coating caused during handling such as scratches, cuts, dents, gouges, not detected during holiday test, having a total reduced thickness on the damaged portion of not less than 2.0 mm and an area not exceeding 20 cm² shall be repaired by applying a heat shrink patch without exposing bare metal surface.
- Defects exceeding the sizes as indicated above or any holidays of size less than 300 mm shall be repaired using heat shrink patch. The defect area shall be exposed up to bare metal prior to application of heat shrink patch
- Defects exceeding the above and in number not exceeding 2 per pipe and linear length not exceeding 500 mm shall be repaired using heat shrinkable sleeves of HTLP 80 or equivalent.
- Pipes with bigger damage shall be stripped and recoated.
- In case of coating defect close to coating cut back, Contractor shall remove the coating throughout the entire circumference of the pipe down to the steel surface and increase the coating cut back length. Now if the coating cut back exceeds 140 mm of linear length of pipe then the coating shall be repaired by the use of heat shrink sleeves thereby making up the coating cut back length of 120 mm.

Notwithstanding the above, if any defect exceeds 70 mm from the original coating cut back length, the entire coating shall be removed and the pipe shall be recycled through the entire coating procedure.

Irrespective of type of repair, the maximum numbers of repair of coating shall be as follows:

- Holiday repair of size ≤ 100 cm² attributable to process of coating application shall be maximum one number per pipe.
- In addition to the above, defects to be repaired by heat shrink patch/sleeve shall be maximum 2 (two) per pipe.

Defects exceeding the above limits shall cause pipe coating rejection, stripping and recoating. The above is exclusive of the repairs warranted due to testing as per this specification.

All repairs carried out to coating for whatever reason shall be to the account of Contractor.

Cosmetic damages occurring in the polyethylene layer only need not be repaired by exposing up to steel surface, as deemed fit by the Company Representative. In any case the Contractor shall establish his material, methods and procedure of repair that result in an acceptable quality of product by testing

| | | | |
|---|---|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYETHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 23 of 26 | |

and shall receive approval from Company prior to use.

Testing of repairs shall be in the same form as testing coating. All repairs shall result in a coating thickness no less than the parent coating thickness. Contractor shall test repairs to coating as and when required by Company.

8.0 MARKING AND PIPE IDENTIFICATION

The Contractor shall preserve pipe identity by maintaining the identity of each joint of pipe. Final markings shall be applied on the outside wall of the pipe at a maximum distance of 500 mm from the end. The marking shall indicate, but not be limited to, the following information:

- i. Pipe number, Heat number.
- ii. Coated pipe number.
- iii. Colour band.
- iv. Diameter, wall thickness, weight and length.
- v. Re attach barcode labels from inside of pipe, or replace labels.
- vi. Any other information considered relevant by Purchaser.
- Vii. Pipe manufacturer"s name
- Viii. Inspection Marks /Punch

Contractor shall obtain prior approval from Company for the marking procedure to be adopted.

9.0 PRODUCTION REPORT

Contractor shall prepare and maintain a detailed production reporting system, which shall provide a detailed history of each pipe length. The Company shall provide pipe manufacturing data files (in MS Excel format) to the Contractor. The pipe manufacturer data files shall, as a minimum, the contain the following data:-

- Pipe number
- Heat number
- Pipe grade
- Diameter
- Length
- Wall thickness
- Pipe weight

Prior to acceptance of the pipe at the wharf, the Contractor in the presence of the Company Representative shall identify and record any minor defects, such as dents, flats or damaged bevels, found during the acceptance inspection. The Contractor shall be responsible for any subsequent damage to the pipe.

The Contractor shall update the pipe data files received from pipe manufacturer by adding coating data. As a minimum, following data shall be added.

- Details of defect repairs, if any, carried out on the bare pipes received
- Coating material batch numbers
- Pre-qualification tests for raw materials
- Coating procedure qualification tests
- Coating material balance
- Coated pipe sampling details
- Coated pipe test results

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 24 of 26 | |

- Coated pipe weight
- Coating defects
- Coating repairs
- Hold points
- Rejected pipe

10.0 QUALITY ASSURANCE

- 10.1.** The Contractor shall have established within his organization and, shall operate for the contract, a documented Quality System that ensures that the requirements of this specification are met in all aspects. The Quality System shall be based upon ISO 9001/2 or equivalent.
- 10.2.** The Contractor shall have established a Quality Assurance Group within its organization that shall be responsible for reviewing the Quality System and ensuring that it is implemented.
- 10.3.** The Contractor shall submit the procedures that comprise the Quality System to the Company for agreement.
- 10.4.** The Contractor's Quality System shall pay particular attention to the control of Suppliers and Sub-contractors and shall ensure that the requirements of this specification are satisfied by the Suppliers and Sub-contractors operating Quality system in their organization.
- 10.5.** The Contractor shall, prior to the commencement of work, prepare and issue a Quality Plan for all of the activities required satisfying the requirements of this specification. The plan shall include any sub-contracted work, for which the sub-contractors Quality Plans shall be submitted. The plan shall be sufficiently detailed to indicate sequentially for each discipline the requisite quality control, inspection, testing and certification activities with reference to the relevant procedures and the acceptance standards.
- 10.6.** The Contractor's Quality system and associated procedures may, with due notice, be subject to formal audits. The application of quality control by the Contractor will be monitored by the Company Representatives who will witness and accept the inspection, testing and associated work required by this specification.

| | | | |
|---|--|-----------------------|------------|
|  | STANDARD SPECIFICATION FOR 3 LAYER POLYTHYLENE COATING OF LINEPIPES | Document No. | Rev |
| | | HOGPL-PL-00003 | 0 |
| | | Page 25 of 26 | |

ANNEXURE-I

LIST OF ACCEPTABLE COMBINATIONS OF COATING MATERIALS

The following combinations of coating materials are considered acceptable. In case any of the combinations listed below are offered, details regarding properties of the offered materials need not be furnished with bid. However, In the event of award of contract, Contractor shall furnish the combination(s) proposed and re-confirmation of compatibility of the proposed combination (s) from the raw materials Manufacturers.

| Epoxy Powder (Manufacturer) | Adhesive (Manufacturer) | PE Compound (Manufacturer) |
|--|------------------------------------|---------------------------------------|
| CORRO-COAT EP-F 2001 (JOTUN) | FUSABOND 158D (DUPONT) | SCLAIR 35 BP HDPE (NOVACOR) |
| PE 50-8190/8191 (BASF) | LUCALEN G3510H (BASF) | LUPOLEN 3652 D SW 00413 (BASF) |
| CORRO-COAT EP-F 2001 (JOTUN) | | |
| PE 50-6109 (BASF) | ME 0420 (BOREALIS) | HE 3450 (BOREALIS) |
| CORRO-COAT EP-F 2001 (JOTUN) | | |
| SCOTCHKOTE 226N (3M) | | |
| CORRO-COAT EP-F 2001 (JOTUN) | LE-149V (S K CORPORATION) | ET 509 B (S K CORPORATION) |

Although the above combinations would be acceptable to Company, the responsibility of suitability for application, performance and compliance to the coating system requirements shall unconditionally lie with the Contractor





| | | | |
|--|--|--|--|
| | | | |
|--|--|--|--|



**INSPECTION AND TEST PLAN FOR
WELDED PIPES**

HOGPL-PL-ITP-001

**INSPECTION AND TEST PLAN FOR
WELDED PIPES**

| REV | DATE | DESCRIPTION | PREP | CHK | APPR |
|-----|------------|--------------------|------|-----|------|
| 0 | 18.05.2021 | ISSUED AS STANDARD | | | |

ABBREVIATIONS

| | | | |
|--------|--------------------------------------|-------------|---|
| CE | Carbon Equivalent | NDT | Non Destructive Testing |
| DFT | Dry Film Thickness | NPSH | Net Positive Suction Head |
| DPT | Dye Penetrant Testing | PO | Purchase Order |
| DHT | De-hydrogen Heat Treatment | PESO | Petroleum Explosive Safety Organization |
| ERTL | Electronics Regional Test Laboratory | PQR | Procedure Qualification Record |
| FCRI | Fluid Control Research Institute | MR | Material Requisition |
| HT | Heat Treatment | PMI | Positive Material Identification |
| HIC | Hydrogen Induced Cracking | RT | Radiography Testing |
| ITP | Inspection and Test Plan | SSCC | Sulphide Stress Corrosion Cracking |
| IP | Ingress Protection | TC | Test Certificate |
| IHT | Intermediate Heat Treatment | TPI or TPIA | Third Party Inspection Agency |
| IC | Inspection Certificate | UT | Ultrasonic Testing |
| IGC | Inter Granular Corrosion | VDR | Vendor Data Requirement |
| MPT/MT | Magnetic Particle Testing | WPS | Welding Procedure Specification |
| MTC | Material Test Certificate | WPQ | Welders Performance Qualification |
| MRT | Mechanical Run Test | | |

1.0 SCOPE:

This Inspection and Test Plan covers the minimum testing requirements of Welded Pipes.

2.0 REFERENCE DOCUMENTS:

PO/MR/ Standards referred there in/ Job specifications /Approved documents.

3.0 INSPECTION AND TEST REQUIREMENTS:

| SL. NO. | STAGE/ ACTIVITY | CHARACTERISTICS | QUANTUM OF CHECK | RECORD | SCOPE OF INSPECTION | | |
|------------|--|--|------------------|---------------------|---------------------|----------|--|
| | | | | | SUB SUPPLIER | SUPPLIER | TPIA |
| 1.0 | Procedure | | | | | | |
| 1.1 | Hydrostatic Test, Heat Treatment, NDT and Other Procedures | Documented Procedures | 100% | Procedure Documents | - | H | R |
| 1.2 | WPS, PQR & WPQ | Welding Parameters & Qualification Record | 100% | WPS, PQR & WPQ | - | H | W- New R- Existing(Qualified under reputed TPIA) |
| 2.0 | Material Inspection | | | | | | |
| 2.1 | Raw Material Inspection | Review of MTC for Chemical & Mechanical Properties | 100% | Test Certificates | - | H | R |

| | | | | | | | |
|------------|---|---|-----------------------------|----------------------------|---|---|---------------------------|
| 3.0 | In Process Inspection | | | | | | |
| 3.1 | Welding | Welding Parameters as per WPS / PQR | 100% | Inspection Reports | - | H | - |
| 3.2 | Heat Treatment | Stress Relieving, Normalising, Tempering, Solution Annealing, Stabilization Heat Treatment etc. as applicable | 100% | HT chart | - | H | R |
| 3.3 | Ferrite Check Of SS Pipes (If Applicable) | % Ferrite Check | Random On Weld | Inspection Report | - | H | R |
| 3.4 | UT/RT As applicable | Surface & Internal Imperfections | MR / Material Specification | RT Films & UT Test Reports | - | H | R (Film review for RT) |
| 3.5 | Identification of Test Samples | Product Chemical, Tensile, Hardness, Impact, IGC and Other test as applicable | Lot as per Specification. | Test Reports | - | H | H |
| 3.6 | Product Analysis | Chemical Composition | MR / Material Specification | Test Reports | - | H | R |
| 3.7 | Destructive Testing | Tensile, Hardness, Impact, IGC and Other test as applicable | Lot as per Specification. | Test Reports | - | H | H |
| 3.8 | Galvanizing (If Applicable) | Integrity Of Galvanised Coating | 100% | Inspection Reports | - | H | R |
| 4.0 | Final Inspection | | | | | | |

| | | | | | | | |
|------------|---|--|--|-------------------|---|---|----------------|
| 4.1 | Hydrostatic Testing | Leak Check | 100% | Test Report | - | H | RW (Min.5%) |
| 4.2 | Visual and Dimensional Inspection (VDI | Surface Condition, Straightness, End Finish, Bevel Angle, Root Face, Outer Dia., Thickness, Length, End Finish, Marking etc. | 100% | Inspection Report | - | H | RW (Min.5%) |
| 4.3 | Weight Checking as applicable | Weight | 100% | Inspection Report | - | H | - |
| 4.4 | PMI Check | Chemical Check | As Per Spec. | Inspection Report | - | H | RW |
| 4.5 | Final Stamping | Stamping of accepted Pipes | Stamping of Pipes which are witnessed by Owner/TPIA. | Inspection Report | - | H | H |
| 5.0 | Painting | | | | | | |
| 5.1 | Rust Preventive Coating & Colour Coding | Visual & Colour Coding as applicable | 100% | Inspection Report | - | H | - |
| 6.0 | Documentation & IC | | | | | | |

| | | | | | | | |
|-----|--|---|------|--------------------|---|---|---|
| 6.1 | Documentation & Inspection Certificate(IC) | Review of Stage Inspection Reports / Test Reports & Issue of IC | 100% | Manufacturer TC&IC | - | H | H |
|-----|--|---|------|--------------------|---|---|---|

Legend: H - Hold (Do not proceed without approval), P - Perform, RW - Random Witness (As specified or 10% [min.1 no. of each size and type of Bulk item]), R - Review, W - Witness (Give due notice, work may proceed after scheduled date).

NOTES (As applicable):

1. This document describes the generic test requirements. Any additional test or Inspection scope if specified in contract documents shall also be applicable. (Unless otherwise agreed upon)
2. Acceptance Norms for all the activities shall be as per PO/MR/STANDARDS referred there in /Job Specification /Approved Documents.
3. For orders placed on stockist, items shall be accepted based on manufacturer's TC with EN310204 type 3.2 certification from VCS / OWNER approved suppliers.



**INSPECTION AND TEST PLAN FOR
SEAMLESS PIPES**

HOGPL-PL-ITP-002

**INSPECTION AND TEST PLAN FOR
SEAMLESS PIPES**

| REV | DATE | DESCRIPTION | PREP | CHK | APPR |
|-----|------------|--------------------|------|-----|------|
| 0 | 18.05.2021 | ISSUED AS STANDARD | | | |

ABBREVIATIONS

| | | | |
|--------|--------------------------------------|-------------|---|
| CE | Carbon Equivalent | NDT | Non Destructive Testing |
| DFT | Dry Film Thickness | NPSH | Net Positive Suction Head |
| DPT | Dye Penetrant Testing | PO | Purchase Order |
| DHT | De-hydrogen Heat Treatment | PESO | Petroleum Explosive Safety Organization |
| ERTL | Electronics Regional Test Laboratory | PQR | Procedure Qualification Record |
| FCRI | Fluid Control Research Institute | MR | Material Requisition |
| HT | Heat Treatment | PMI | Positive Material Identification |
| HIC | Hydrogen Induced Cracking | RT | Radiography Testing |
| ITP | Inspection and Test Plan | SSCC | Sulphide Stress Corrosion Cracking |
| IP | Ingress Protection | TC | Test Certificate |
| IHT | Intermediate Heat Treatment | TPI or TPIA | Third Party Inspection Agency |
| IC | Inspection Certificate | UT | Ultrasonic Testing |
| IGC | Inter Granular Corrosion | VDR | Vendor Data Requirement |
| MPT/MT | Magnetic Particle Testing | WPS | Welding Procedure Specification |
| MTC | Material Test Certificate | WPQ | Welders Performance Qualification |
| MRT | Mechanical Run Test | | |

1.0 SCOPE:

This Inspection and Test Plan covers the minimum testing requirements of Seamless Pipes.

2.0 REFERENCE DOCUMENTS:

PO/MR/ Standards referred there in/ Job specifications /Approved documents.

3.0 INSPECTION AND TEST REQUIREMENTS:

| SL. NO. | STAGE/ ACTIVITY | CHARACTERISTICS | QUANTUM OF CHECK | RECORD | SCOPE OF INSPECTION | | |
|------------|--|---|------------------|---------------------|---------------------|----------|------|
| | | | | | SUB SUPPLIER | SUPPLIER | TPIA |
| 1.0 | Procedure | | | | | | |
| 1.1 | Hydrostatic Test, Heat Treatment, NDT and Other Procedures | Documented Procedures | 100% | Procedure Documents | - | H | R |
| 2.0 | Material Inspection | | | | | | |
| 2.1 | Raw Material Inspection | Review of MTC for Chemical, Mechanical Properties, size & steel making process, etc. | 100% | Test Certificates | - | H | R |
| 3.0 | In Process Inspection | | | | | | |
| 3.1 | Heat Treatment as applicable | Normalizing, Tempering, Solution Annealing, Stabilization Heat Treatment etc. as applicable | 100% | HT chart | - | H | R |

| | | | | | | | |
|------------|---|--|--------------------------------|--------------------|---|---|----------------|
| 3.2 | NDT As applicable | Surface & Internal Imperfections | PR / Purchase Specification | NDT Reports | - | H | R |
| 3.3 | Identification of Test Samples | Product Chemical, Tensile, Hardness, Impact, IGC and Other test as applicable | Lot as per specification | Test Reports | - | H | H (Note-1) |
| 3.4 | Product Analysis | Chemical Composition | Lot as per specification | Test Reports | - | H | R |
| 3.5 | Destructive Testing | Mechanical, Impact, IGC and Other test as applicable | Lot as per specification | Test Reports | - | H | H (Note-1) |
| 3.6 | Galvanizing (If Applicable) | Integrity Of Galvanised Coating | 100% | Inspection Reports | - | H | R |
| 4.0 | Final Inspection | | | | | | |
| 4.1 | Hydrostatic Testing | Leak Check | 100% | Test Report | - | H | RW (Note-1) |
| 4.2 | Visual and Dimensional Inspection (VDI) | Surface Condition, Straightness, End Finish, Bevel Angle, Root Face, Outer Dia., Thickness, Length, End Finish, Marking, End Caps etc. | 100% | Inspection Report | - | H | RW (Note-1) |
| 4.3 | Weight Checking as applicable | Weight | 100% | Inspection Report | - | H | - |

| | | | | | | | |
|------------|---|---|---|-------------------|---|---|----|
| 4.4 | PMI Check | Chemical Check | As Per Spec. | Inspection Report | - | H | RW |
| 4.5 | Final Stamping | Stamping of accepted Pipes | Stamping of Pipes which are witnessed by TPIA. Other pipes to have suppliers identification | Inspection Report | - | H | H |
| 5.0 | Painting | | | | | | |
| 5.1 | Rust Preventive Coating & Colour Coding as applicable | Visual & Colour Coding as applicable | 100% | Inspection Report | - | W | - |
| 6.0 | Documentation & IC | | | | | | |
| 6.1 | Documentation & Inspection Certificate(IC) | Review of Stage Inspection Reports / Test Reports & Issue of IC | 100% | Supplier TC&IC | - | H | H |

Legend: H - Hold (Do not proceed without approval), P - Perform, RW - Random Witness (As specified or 10% [min.1 no. of each size and type of Bulk item]), R - Review, W - Witness (Give due notice, work may proceed after scheduled date).

NOTES (As applicable):

1. Carbon Steel Pipes (Other than LTCS & Pipes for special services like NACE, H2, HIC, etc.) up to size 12" will be accepted on review of Supplier Test Certificates. Supplier Test Certificate to be reviewed by Owner/TPIA.
2. This document describes the generic test requirements. Any additional test or Inspection scope if specified in contract documents shall also be applicable. (Unless otherwise agreed upon)
3. Acceptance Norms for all the activities shall be as per PO/MR/STANDARDS referred there in /Job Specification /Approved Documents.
4. For orders placed on stockist, items shall be accepted based on manufacturer's TC with EN310204 type 3.2 certification from VCS / OWNER approved suppliers.



**INSPECTION AND TEST PLAN FOR
3-LAYER PE COATING OF LINE PIPES**

HOGPL-PL-ITP-003

**INSPECTION AND TEST PLAN FOR
3-LAYER PE COATING OF LINE PIPES**

| REV | DATE | DESCRIPTION | PREP | CHK | APPR |
|-----|------------|--------------------|------|-----|------|
| 0 | 18.05.2021 | ISSUED AS STANDARD | | | |

ABBREVIATIONS

| | | | |
|--------|--------------------------------------|-------------|---|
| CE | Carbon Equivalent | NDT | Non Destructive Testing |
| DFT | Dry Film Thickness | NPSH | Net Positive Suction Head |
| DPT | Dye Penetrant Testing | PO | Purchase Order |
| DHT | De-hydrogen Heat Treatment | PESO | Petroleum Explosive Safety Organization |
| ERTL | Electronics Regional Test Laboratory | PQR | Procedure Qualification Record |
| FCRI | Fluid Control Research Institute | MR | Material Requisition |
| HT | Heat Treatment | PMI | Positive Material Identification |
| HIC | Hydrogen Induced Cracking | RT | Radiography Testing |
| ITP | Inspection and Test Plan | SSCC | Sulphide Stress Corrosion Cracking |
| IP | Ingress Protection | TC | Test Certificate |
| IHT | Intermediate Heat Treatment | TPI or TPIA | Third Party Inspection Agency |
| IC | Inspection Certificate | UT | Ultrasonic Testing |
| IGC | Inter Granular Corrosion | VDR | Vendor Data Requirement |
| MPT/MT | Magnetic Particle Testing | WPS | Welding Procedure Specification |
| MTC | Material Test Certificate | WPQ | Welders Performance Qualification |
| MRT | Mechanical Run Test | | |

1.0 SCOPE:

This Inspection and Test Plan covers the minimum testing requirements of 3-Layer PE Coating of Line pipes.

2.0 REFERENCE DOCUMENTS:

PO/MR/ Standards referred there in/ Job specifications /Approved documents.

3.0 INSPECTION AND TEST REQUIREMENTS:

| SL. NO. | STAGE/ ACTIVITY | CHARACTERISTICS | QUANTUM OF CHECK | RECORD | SCOPE OF INSPECTION | | |
|------------|--|--|------------------|--------------------------------|---------------------|----------|------|
| | | | | | SUB SUPPLIER | SUPPLIER | TPIA |
| 1.0 | Procedure | | | | | | |
| 1.1 | Coating application, testing and Other Procedures | Documented Procedures | 100% | Procedure Documents | - | H | R |
| 2.0 | Material Inspection | | | | | | |
| 2.1 | Epoxy powder, Adhesive & Polyethylene compound | All the properties as per Material specification | 100% | Manufacturer Test Certificates | H | R | R |
| 3.0 | In Process Inspection | | | | | | |
| 3.1 | Epoxy powder, Adhesive & Polyethylene compound check testing | Properties as per Material specification | 100% | Test Reports | - | H | H |

| | | | | | | | |
|------------|---|---|-------------------------------|------------------------|---|---|--------------------|
| 3.2 | Coating Procedure qualification | All the testing as per Material specification | As per Material Specification | Inspection/Test Report | - | H | H |
| 3.3 | Incoming Pipes | Visual inspection ,marking verification & correlation with mill TC/Tally sheet | 100% | Supplier Data Sheet | - | H | - |
| 3.4 | Blast Cleaning | Pre Heating, Elapsed time, Degree of cleaning,, Surface Profile, Contamination of shots/grits, salt level, Degree of dust & roughness | 100% | Inspection Reports | - | H | RW (Min.1%) |
| 3.5 | Lab test for Chromate, Phosphoric acid & de-ionized water (as applicable) | Properties as per purchase specification / Manufacturer TC | As per Material Specification | Inspection Reports | - | H | RW (Once in a Day) |
| 3.6 | Phosphoric acid wash followed by de-ionized water wash (as applicable) | Visual, PH Value, salt level etc. | 100% | Inspection Reports | - | H | RW (Once in a Day) |
| 3.7 | Chromate Treatment (as applicable) | Uniform application as per Manufacturer's recommendation | 100% | Inspection Reports | - | H | RW (Once in a Day) |
| 3.8 | Coating application | Preheating temperature, Inter coat time, line speed, Adhesive / PE film temperature, Overlap of layers etc. | 100% | Inspection Reports | - | H | RW (Min.1%) |
| 3.9 | Epoxy and adhesive Thickness on semi coated pipe | Visual, Thickness, overlap, Adhesion test (St Andrew's Cross Cut method) etc. | As per Material Specification | Inspection Reports | - | H | RW (Once in a Day) |
| 4.0 | Final Inspection | | | | | | |

| | | | | | | | |
|-----|--------------------------------|---|--------------------------------|-------------------|---|---|--------------------|
| 4.1 | Holiday detection at 25KV | Pin hole, coating damage & Other through thickness defects. | 100% | Inspection Report | - | H | RW (Min.1%) |
| 4.2 | Visual and Dimensional | Visual, coating thickness, Cut back dimension, Marking , colour coding etc. | 100% | Inspection Report | - | H | RW (Min.1%) |
| 4.3 | Impact test | No coating damage @ specified Energy | As per Material Specification | Inspection Report | - | H | RW (Once in a Day) |
| 4.4 | Peel Test | Bond strength, mode of failure, rate of peeling etc. | As per Material Specification | Inspection Report | - | H | RW (Min.1%) |
| 4.5 | Resistance to indentation test | Hardness against indentation | As per Material Specification. | Inspection Report | - | H | RW (Once in a Day) |
| 4.6 | Cathodic Disbondment Test | Disbonded area / Equivalent circle radius (ECR) | As per Material Specification | Inspection Report | - | H | W |
| 4.7 | Visual (Air Entrapment) | Air entrapment between the layers | As per Material Specification | Inspection Report | - | H | RW (Min.1%) |
| 4.8 | Degree of Cure Test | Cure %, Glass Transition Temp(H and Tg) | As per Material Specification | Inspection Report | - | H | RW (Once in a Day) |

| | | | | | | | |
|------------|---|---|-------------------------------|---|---|---|---|
| 4.9 | Calibration of measuring Instruments / Holiday tester | Verify Accuracy | As per Material Specification | Calibration Report | - | H | R |
| 4.10 | Handling, Load out & Transportation (Bare & coated pipes) | Pipes stacking & weather protection | As per Material Specification | Inspection Report | - | H | - |
| 5.0 | Documentation & IC | | | | | | |
| 5.1 | Documentation & Inspection Certificate(IC) | Review of Stage Inspection Reports / Test Reports & Issue of IC | 100% | Manufacturer TC&IC | - | H | H |
| 5.1 | Final Document submission | Compilation of Inspection / Test reports as per VDR / PR | 100% | Final data folder /Completeness certificate | - | H | H |

Legend: H - Hold (Do not proceed without approval), P - Perform, RW - Random Witness (As specified or 10% [min.1 no. of each size and type of Bulk item]), R - Review, W - Witness (Give due notice, work may proceed after scheduled date).

NOTES (As applicable):

1. This document describes the generic test requirements. Any additional test or Inspection scope if specified in contract documents shall also be applicable. (Unless otherwise agreed upon)
2. Acceptance Norms for all the activities shall be as per PO/MR/STANDARDS referred there in /Job Specification /Approved Documents.



CHECKLIST - TECHNICAL

HOGPL-SD-CK-001

CHECKLIST – TECHNICAL

Bidder confirms following, as a minimum, has been enclosed in the offer.

| S.NO. | Requirements | Compiled by Bidder(Tick) |
|-------|--|--------------------------|
| 1 | Reference List of previous supply of Procured item | <input type="checkbox"/> |
| 2 | Filled – up Data Sheets, duly signed and stamped by bidder enclosed. | <input type="checkbox"/> |
| 3 | List of recommended commissioning spares and accessories for Procured item. | <input type="checkbox"/> |
| 4 | List of recommended spares and accessories for two year normal operation for procured item. | <input type="checkbox"/> |
| 5 | Compliance statement duly filled and stamped enclosed. | <input type="checkbox"/> |
| 6 | GA & assembly drawings, cross section drawings including part list & material list enclosed. | <input type="checkbox"/> |
| 7 | Other technical details & vendor’s product catalogues enclosed. | <input type="checkbox"/> |

| | | | | | |
|------------|-------------|--------------------|-------------|------------|-------------|
| | | | | | |
| 0 | 18.05.2021 | ISSUED AS STANDARD | | | |
| REV | DATE | DESCRIPTION | PREP | CHK | APPR |



COMPLIANCE STATEMENT

HOGPL-SD-CS-001

COMPLIANCE STATEMENT

| S.No | Requirement | Bidder's Confirmation |
|------|--|-----------------------|
| 1 | Bidder confirms that all materials proposed by the bidder are same/ superior to those specified in specification/ data sheets enclosed. | |
| 2 | Bidder confirms that the offer is in total compliance with the Technical requirements of the Material Requisition. Bidder confirms that deviation expressed or implied anywhere else in the offer shall not be considered valid. | |
| 3 | Bidder confirms that all spares and accessories required for two years of normal operation have been quoted separately. | |
| 4 | Bidder confirms that prices for start-up/commissioning spares and accessories have been included in the quoted items. | |
| 5 | Bidder confirms that in the event of securing order for the requisitioned item(s), good for manufacturing drawings of ordered item(s) shall have complete details with dimensions, part list and material list including back-up calculations in the first submission, failing which the vendor shall be solely responsible for any likely delay in delivery of item(s). | |

Bidder's Signature with Stamp

| | | | | | |
|------------|-------------|--------------------|-------------|------------|-------------|
| | | | | | |
| 0 | 18.05.2021 | ISSUED AS STANDARD | | | |
| REV | DATE | DESCRIPTION | PREP | CHK | APPR |



INSTRUCTION TO BIDDER

HOGPL-SD-ITB-001

INSTRUCTION TO BIDDERS

1. Bidder to note that no correspondence shall be entered into or entertained after the bid submission.
2. Bidder shall furnish quotation only in case he can supply material strictly as per this Material Requisition and specification/data sheet forming part of Material Requisition.
3. If the offer contains any technical deviations or clarifications or stipulates any technical specifications (even if in line with MR requirements) and does not include complete scope & technical / performance data required to be submitted with the offer, the offer shall be liable for rejection.
4. Bidder must submit all documents as listed in checklist with his offer.
5. Supplier must note that stage wise inspection for complete fabrication, testing including the raw material inspected to be carried out.
6. Vendors for bought out items to be restricted to the approved vendor list attached with bid document. Approval of additional vendor if required, for all critical bought out items shall be obtained by the supplier from the purchaser before placement of order. Credentials/PTR of the additional vendor proposed to be submitted by supplier for review and approval of Purchaser/ Purchaser's representative

| | | | | | |
|------------|-------------|---------------------|-------------|------------|-------------|
| | | | | | |
| 0 | 18.05.2021 | ISSUED AS STANDARDS | | | |
| REV | DATE | DESCRIPTION | PREP | CHK | APPR |



**CITY GAS DISTRIBUTION PROJECT
OF
Nagaland GA**

| | | | | | | |
|----------------------|------|-----|----------------------|----|-----|--|
| SCOPE OF WORK | | | CLIENT JOB NO | | | |
| | | | TOTAL SHEETS | | 09 | |
| DOCUMENT NO | 1001 | CGD | PL | SW | 001 | |

HPOIL GAS PRIVATE LIMITED

**CITY GAS DISTRIBUTION PROJECT
OF
Nagaland GA**

**PROCUREMENT OF
COATED LINE PIPES**

| | | | | | |
|------------|-------------|------------------------|--|-------------|-------------|
| | | | | | |
| | | | | | |
| D1 | 18.05.2021 | ISSUED FOR PROCUREMENT | | | |
| REV | DATE | DESCRIPTION | | PREP | CHK |
| | | | | | APPR |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

TABLE OF CONTENTS

1.0 INTRODUCTION 3
 2.0 SCOPE 3
 3.0 DETAILS OF LINE PIPE 4
 4.0 DELIVERY 5
 5.0 WORKS ASSOCIATED WITH COATING (EXTERNAL & INTERNAL) OF LINE PIPES/
 SUPPLY OF COATED LINE PIPES..... 5

ATTACHMENTS

- TYPICAL LAYOUT FOR STORAGE YARD: SD-PL-001
- TYPICAL DRAWING FOR BARBED WIRE FENCING SD-SV-001

| | | | |
|--|---|---------------------|------------|
| | SCOPE OF WORK FOR PROCUREMENT OF BARE/ COATED LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 2 of 9 | |



CITY GAS DISTRIBUTION PROJECT OF Nagaland GA

1.0 INTRODUCTION

Hindustan Petroleum Corporation Limited (HPCL) is a Central Public Sector with a Navratna Status, and a Forbes 2000 and Global Fortune 500 company incorporated in 1974 engaged in refining and marketing of petroleum products with its headquarter in Mumbai, Maharashtra.

Oil India Limited (OIL) is a premier Indian National Oil Company engaged in the business of exploration, development and production of crude oil and natural gas, transportation of crude oil and production of LPG founded in 1959 with its headquarters in Duliajan, Assam.

A JVC has been incorporated in the name of HPOIL GAS PRIVATE LIMITED, which has received the authorization from PNGRB vide letter PNGRB/CGD/BID/8/2018/GA/Ambala-Kurukshetra District dated 22/02/2018 to Lay, Build and Operate City Gas Distribution networks in Ambala-Kurukshetra and vide letter PNGRB/CGD/BID/8/2017/BEC/GA-Kolhapur dated 06/03/2018 to Lay, Build and Operate City Gas Distribution networks in Kolhapur District.

2.0 SCOPE

The scope of works includes supply of coated line pipe in the requisition and includes the following:

A. Carrying out all works associated with manufacture and supply of line pipes as per specifications HOGPL-PL-00001 & OR HOGPL-PL-00002, application of 3-layer side extruded polyethylene external corrosion protection coating as per specification no. HOGPL-PL-00003 as per details covered herein and transportation of coated pipes to designated storage yards including arrangement & maintenance of Storage Yards till handling over to installation contractor.

B. WORKS AT STORAGE YARD

- Land for Storage Yards adjacent to State highway/ National highway near to RoU will be made available by the owner.
- Development of Storage Yards as detailed herein shall be done by client or client representative.
- Handling & stacking of bare and coated line pipes at Storage Yards shall be done by bidder.
- For detail work in storage yard Bidder to refer clause no 5.3

| | | | |
|--|---|---------------------|------------|
| | SCOPE OF WORK FOR PROCUREMENT OF BARE/ COATED LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 3 of 9 | |



**CITY GAS DISTRIBUTION PROJECT
AT Nagaland GA**

and testing, repairing of coating defects, re-testing, any cutting of pipes for the purpose of PQT or regular production testing, carrying out re-beveling and all associated works after cutting etc. and carrying out all coating works as per specification no. SS-PL-02. Application shall also include coating of pipes of non-standard lengths obtained in case of cutting of bare pipes necessitated for removal of dents/defects.

- v. Pipe surfaces shall be cleaned to SA 2½ (in accordance with ISO 8502 -3) using suitable grit/ shot, free of any deleterious contamination or moisture. The surface roughness shall be checked at random and shall be of the range of 30-60 microns in accordance with ISO 4287-1.
- vi. Loose dust and residual abrasive, which may be developed inside the pipe during blasting process, shall be removed by high pressure air blow.
- vii. The coating plant details shall be included in the bid.

5.2 Materials to be Supplied by Bidder

Bidder shall procure and supply in sequence and at appropriate time, all corrosion coating materials, repair materials, all accessories, consumables and utilities required for completion of works. The rates quoted for the execution of the work shall be inclusive of supply of these materials. All materials supplied shall be strictly in accordance with the requirements of relevant applicable Company specifications enclosed.

Materials to be supplied shall include, but not limited to, the following:

- a. All materials and equipment required for repair, re-beveling and / or cutting out defects of bare pipes.
- b. All consumables, equipment required for surface cleaning / preparation etc.
- c. All coating materials and other materials, equipment, consumables as required for coating.
- d. All materials and equipment required for conducting all types of inspection and tests including non-destructive testing of pipes after rebeveling/ grinding.
- e. All materials and equipment required for repairing of defects of coated pipes and thereafter re-testing.
- f. All equipment, tools, tackles, trucks/ trailers, devices required for loading, transportation, hauling, handling, unloading, stacking, and storage of bare/ coated pipes.
- g. Any other items not mentioned above but required for timely completion of work in all respect.

| | | | |
|--|---|---------------------|------------|
| | SCOPE OF WORK FOR PROCUREMENT OF BARE/ COATED LINE PIPES | Document No. | Rev |
| | | 1001-CGD-PL-SW-001 | D1 |
| | | Page 6 of 9 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

5.3 Works associated with Storage Yards.

- i. Land for Storage Yards adjacent to State highway/ National highway approach and near to RoU will be made available to the bidder.
- ii. Number of layers for pipes in storage yard shall be chosen to ensure safe handling of pipes and free movement of trailers.
- iii. Calculation for stacking arrangement for bare/ coated pipes and number of layers of pipes at Storage Yards shall be submitted by the coating contractor and approved by the Company.
- iv. Pipes of different diameter ,thicknesses shall be stacked separately.
- v. Bidder shall inspect of all coated line pipes in presence of company representative while handing over of pipes. Repair of damaged pipes, beveled end defects and damaged coating (including supply of coating materials for repair) noticed at the time of handing over of coated pipes. All handling, lifting tools etc. required for inspection of bare line pipes at Storage Yards shall be carried out by the bidder.
- vi. A schematic Sketch of pipeline & Route map is enclosed for bidder reference
- vii. A typical layout of Storage Yards, Sketch No. SD-PL-032 is enclosed for reference purposes. The area within Storage Yards shall be chosen to ensure safe handling of pipes, pipe stacking and free movement of trailers.
- viii. The coated pipes within the Storage Yards may be stacked by placing them on ridges of sand free from stones and covered with a plastic film or on wooden supports provided with suitable cover. Supply of sand and other materials shall be in Bidder's scope. This cover may consist of dry, germ free straw with a plastic film, otherwise foam rubber shall be used. The support shall be spaced in such a manner as to avoid permanent bending of the pipes. Bare pipe stacks shall consist of limited number of layers so that overstressing & deformation of the pipe is avoided.
- ix. In case of coated pipes, stacks shall consist of limited number of layers so that the pressure exercised by the pipe's own weight does not cause deformation of the line pipe/ damages to coating. Each section shall be separated by means of spacers suitably spaced for this purpose.
- x. The submission of prices by the Bidder shall be construed to mean that he has confirmed compliance with all technical specifications of the corresponding item(s) and scope of work.

5.4 Other Requirements

- i. The coating plant, equipment, machinery and other facilities shall be in good operating condition to meet the job requirement of quality and production. Worn out or improvised plant are not acceptable. The coating plant(s) for the work shall be of size and capacity that shall be suitable for the scale of work, production rate, time schedule specified elsewhere in the tender document.

| | | | |
|--|---|---------------------|------------|
| | SCOPE OF WORK FOR PROCUREMENT OF BARE/ COATED LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 7 of 9 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

- ii. All external coating materials shall be as per specification no. SS-PL-02 and those for internal coating shall be as per details covered in this document. The bidder's proposed coating raw material supplier(s) shall be manufacturer of the materials meant for the three-layer side extruded polyethylene coating. He must have manufactured and supplied the offered grades of materials within the last five years reckoned from the bid due date. Bidder's offer shall be unconditional irrespective of the finally qualified raw material manufacturer(s).
- iii. Bidder shall, at his own responsibility and cost, provide and prepare all necessary area for the storage of pipes and all other materials for coating yard, stock piling, and other temporary installation. Bidder shall provide servitude agreements as required with the relevant authorities and on work completion to clean, restore and pay settlements and claim for damages.
- iv. It is mandatory for the Bidder to provide all testing instruments/ equipment required for qualification, pre-production and regular production testing with adequate inventory to carry out tests required within the coating yard. No outside testing is acceptable for this purpose.
- v. Bidder shall, at his own responsibility and cost, provide water and power supply and other utilities, obtain permit regarding access roads and other permits required for the execution of works conforming to all the requirements of the governing authorities.
- vi. All handling, loading, unloading, stacking/storing shall be done in such a manner as to minimize mechanical damages & corrosion and as per the procedure approved by the Company.
 - All handling shall be done with slings or padded hooks.
 - Trailers shall be cleaned of debris or any other substance that might damage the pipe
 - Suitable timber and other dunnage shall be used to protect the pipes against the damage during transit.
 - Loading shall be done in accordance with API RP 5L1 and procedure approved by the Company.
 - Finished pipe to be stored for a significant period of time in the coating yard in a manner to prevent corrosion and damages to the coating.
- vii. A coating specialist shall be made available during entire duration of coating works.
- viii. Coating wastage generated due to standard cut backs on external coating shall be the property of the Bidder.
- ix. Any other works not listed specifically herein but required to be carried out by the Bidder in order to complete the job in all respects, shall also form a part of Bidder's scope.

| | | | |
|---|---|---------------------|------------|
|  | SCOPE OF WORK FOR PROCUREMENT OF BARE/ COATED LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 8 of 9 | |



**CITY GAS DISTRIBUTION PROJECT
OF Nagaland GA**

5.5 Inspection of Field Test and Warranty

- i. Purchaser shall be reimbursed by Manufacturer for any pipe furnished on this order that fails under field hydrostatic test if such failure is caused by a material/manufacturing defect in the pipe. The reimbursement cost shall include pipe, labour and equipment rental for finding, excavating, cutting out and installation of replaced pipe in position. The field hydrostatic test pressure will not exceed that value which will cause a calculated hoop stress equivalent to 95 percent of specified minimum yield strength.
- ii. In case Manufacturer so desires, he will be advised at least two weeks in advance so that his representative may witness the hydrostatic test in field, however, the testing and leak (if any) finding and repair operation shall not be postponed because of absence of the Manufacturer’s Representative.

6.0 ATTACHMENTS:

- 1. Typical layout of Storage Yards: SD-PL-001
- 2. Barbed wire fencing: SD-SV-001

| | | | |
|--|---|---------------------|------------|
| | SCOPE OF WORK FOR PROCUREMENT OF BARE/ COATED LINE PIPES | Document No. | Rev |
| | | | D1 |
| | | Page 9 of 9 | |


TYPICAL LAYOUT PLAN FOR
DUMP SITE DEVELOPMENT

DRAWING NO.

SD-PL-001

SHEET NO.

1 OF 1

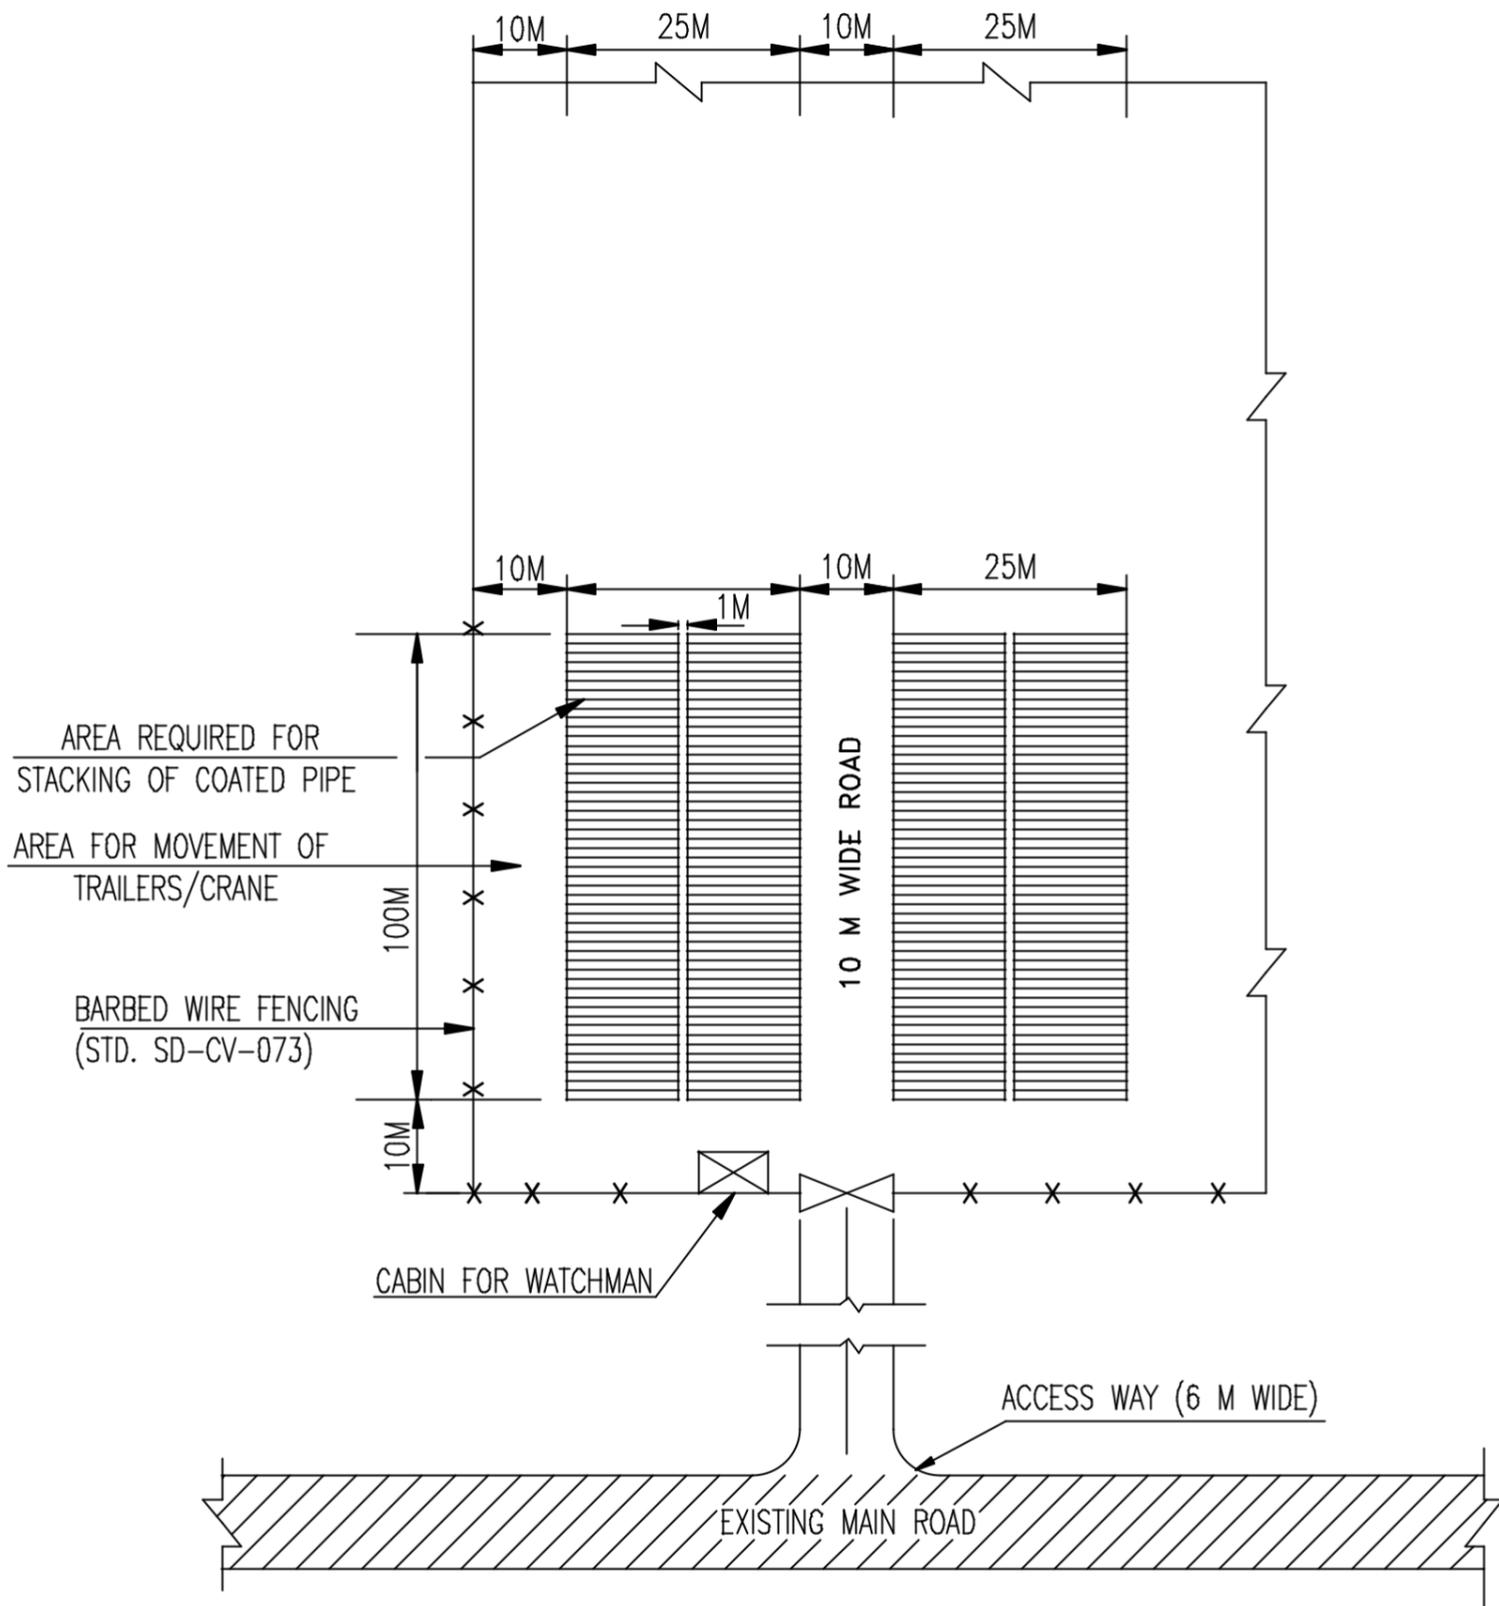

NOTES :

1. ARRANGEMENT SHOWN IS INDICATIVE ONLY AND SHALL BE DEVELOPED BY CONTRACTOR/VENDOR DEPENDING UPON THE AREA REQUIRED.
2. DEVELOPMENT OF DUMPSITE SHALL BE AS PER SCOPE OF WORK DOCUMENT.
3. AREA FOR DUMPSITE SHALL BE FINALISED BASED ON LINE PIPES QUANTITIES.
4. STACKING AND NO. OF LAYER OF PIPE SHALL BE APPROVED BY COMPANY.

| | | | |
|----------|----------|---------------------|--|
| 0 | 04.02.19 | ISSUED WITH TENDER | |
| REV. NO. | DATE | SUBJECT OF REVISION | |

DETAIL - X

7 0 0
CONC. BLOCK
(M-10)
(750X600X750)
REV_0 18.05.21
1 5 0

Ø8 mm 300 LONG
THREADED UPTO THE BLOCK

ISSUED AS STANDARD

Prepared By Reviewed By Approved By Approved By

FIXING DETAIL OF
STRAINING BOLT

DETAIL OF BARBED WIRE FENCING
(WITH ANGLE IRON POST)

DRAWING NO.
HOGPL-CV-001

REV.
0